

Warning

D1054 is an isolated Intrinsically Safe Associated Apparatus located in Non Hazardous Locations within the specified operating temperature limits Tamb -20 to +60 °C, and connected to equipment with a maximum limit for AC power supply Um of 250 Vrms.

Not to be connected to control equipment that uses or generates more than 250 Vrms or Vdc with respect to earth ground.

D1054 must be installed, operated and maintained only by qualified personnel, in accordance to the relevant national/international installation standards (e.g. ANSI/ISA RP12.06.01 Installation of Intrinsically Safe System for Hazardous (Classified) Locations, National Electrical Code NEC ANSI/NFPA 70 Section 504 and 505, Canadian Electrical Code CEC) following the established installation rules, particular care shall be given to segregation and clear identification of I.S. conductors from non I.S. ones.

Warning: substitution of components may impair Intrinsic Safety.

Avertissement: le remplacement des composants peut dégrader la Sécurité Intrinsèque

Warning: de-energize main power source (turn off power supply voltage) and disconnect plug-in terminal blocks before opening the enclosure to avoid electrical shock when connected to live hazardous potential.

Avertissement: couper la source d'alimentation principale (tension d'alimentation) et débrancher les blocs de jonction enfichables avant d'ouvrir l'enveloppe pour éviter un choc électrique lorsqu'il est connecté à un potentiel active dangereux.

Explosion Hazard: to prevent ignition of flammable or combustible atmospheres, disconnect power before servicing.

Danger d'Explosion: pour prévenir une inflammation de l'atmosphère inflammable ou combustible, couper l'alimentation avant de réparer.

The enclosure provides, according to EN60529, an IP20 minimum degree of mechanical protection (or similar to NEMA Standard 250 type 1) for indoor installation, outdoor installation requires an additional enclosure with higher degree of protection (i.e. IP54 to IP65 or NEMA type 12-13) consistent with the effective operating environment of the specific installation. Units must be protected against dirt, dust, extreme mechanical (e.g. vibration, impact and shock) and thermal stress, and casual contacts.

If enclosure needs to be cleaned use only a cloth lightly moistened by a mixture of detergent in water.

Any penetration of cleaning liquid must be avoided to prevent damage to the unit.

Failure to properly installation or use of the equipment may risk to damage the unit or severe personal injury.

The unit cannot be repaired by the end user and must be returned to the manufacturer or his authorized representative. Any unauthorized modification must be avoided.

Technical Data

Supply: 12-24 Vdc nom (10 to 30 Vdc) reverse polarity protected, ripple within voltage limits ≤ 5 Vpp.

Current consumption @ 24 V: 90 mA with 20 mA input/output and relays energized.

Current consumption @ 12 V: 190 mA with 20 mA input/output and relays energized.

Power dissipation: 1.7 W with 24 V supply, 20 mA input/output and relays energized.

Max. power consumption: at 30 V supply voltage, input short circuit, overload condition, relays energized and PPC1090 connected, 2.9 W.

Isolation (Test Voltage): I.S. In/Outs 1.5 KV; I.S. In/Supply 1.5 KV; Analog Out/Supply 500 V; Analog Out/Alarm Outs 1.5 KV; Alarm Outs/Supply 1.5 KV; Alarm Out/Alarm Out 1.5 KV.

Input: 0/4 to 20 mA (separately powered input, voltage drop ≤ 1 V) or 4 to 20 mA (2 wire Tx current limited at ≈ 25 mA).

Integration time: 100 ms.

Resolution/Visualization: 1 μ A.

Input range: 0 to +22 mA.

Transmitter line voltage: ≥ 15.0 V at 20 mA with max. 20 mVrms ripple on 0.5 to 40 KHz frequency band.

Burnout: enabled or disabled. Analog output can be programmed to detect burnout condition with downscale or highsacle forcing. Alarms can be programmed to detect burnout condition.

Burnout range: low and high separated trip point value programmable between -5 to +25 mA.

Output: 0/4 to 20 mA, on max. 600 Ω load source mode, current limited at 22 mA or 0/1 to 5 V or 0/2 to 10 V signal, limited at 11 V.

Resolution: 1 μ A current output or 1 mV voltage output.

Transfer characteristic: linear or reverse.

Response time: ≤ 50 ms (10 to 90 % step change).

Output ripple: ≤ 20 mVrms on 250 Ω communication load on 0.5 to 40 KHz band.

Frequency response: 0.5 to 40 KHz bidirectional within 3 dB (Hart and higher frequency protocols) only with mA direct current output.

Alarm:

Trip point range: within rated limits of input sensor (see input for step resolution).

ON-OFF delay time: 0 to 1000 s, 100 ms step, separate setting.

Hysteresis: 0 to 5 mA (see input for step resolution).

Output: voltage free SPST relay contact.

Contact rating: 2 A 250 Vac 500 VA, 2 A 250 Vdc 80 W (resistive load).

Performance: Ref. Conditions 24 V supply, 250 Ω load, 23 \pm 1 °C ambient temperature.

Input:

Calibration and linearity accuracy: $\leq \pm 20$ μ A

Temperature influence: $\leq \pm 1$ μ A of input for a 1 °C change.

Analog Output:

Calibration accuracy: $\leq \pm 0.1$ % of full scale.

Linearity error: $\leq \pm 0.05$ % of full scale.

Supply voltage influence: $\leq \pm 0.05$ % of full scale for a min to max supply change.

Load influence: $\leq \pm 0.05$ % of full scale for a 0 to 100 % load resistance change.

Temperature influence: $\leq \pm 0.01$ % on zero and span for a 1 °C change.

Environmental conditions: Operating: temperature limits -20 to + 60 °C, relative humidity max 90 % non condensing, up to 35 °C.

Storage: temperature limits - 45 to + 80 °C.

Safety Description:

associated apparatus for use in Non Hazardous Locations, [AEx ia], [Ex ia].

Provides intrinsically safe circuits for use in Class I, Division 1, Groups A, B, C, D; Class II, Division 1, Groups E, F, G; Class III, Division 1 and Class I, Zone 0, Group IIC Hazardous Locations.

Approvals: UL & C-UL E222308 conforms to UL 913 (Div. 1, 8th Ed., Rev. 2013-12-06), UL 60079-0 (General, All Zones, 6th Ed.), UL 60079-11 (Intrinsic Safety "I" Zones 0 & 1, 6th Ed.),

UL 61010-1 (3rd Ed., Rev. 2012-05-11) for UL

and CAN/CSA-C22.2 No. 157-92 (Reaffirmed 2012, Div. 1), CAN CSA-C22.2 No. 60079-0:11 (General, All Zones), CAN/CSA-C22.2 No. 60079-11:14 (Intrinsic Safety "I" Zones 0 & 1),

CAN/CSA-C22.2 No. 61010-1-12 (3rd Ed.) for C-UL.

Mounting: T35 DIN Rail according to EN50022.


Weight: about 175 g.

Connection: by polarized plug-in disconnect screw terminal blocks to accomodate terminations up to 2.5 mm².

Location: Non Hazardous Locations.

Protection class: IP 20.

Dimensions: Width 22.5 mm, Depth 99 mm, Height 114.5 mm.

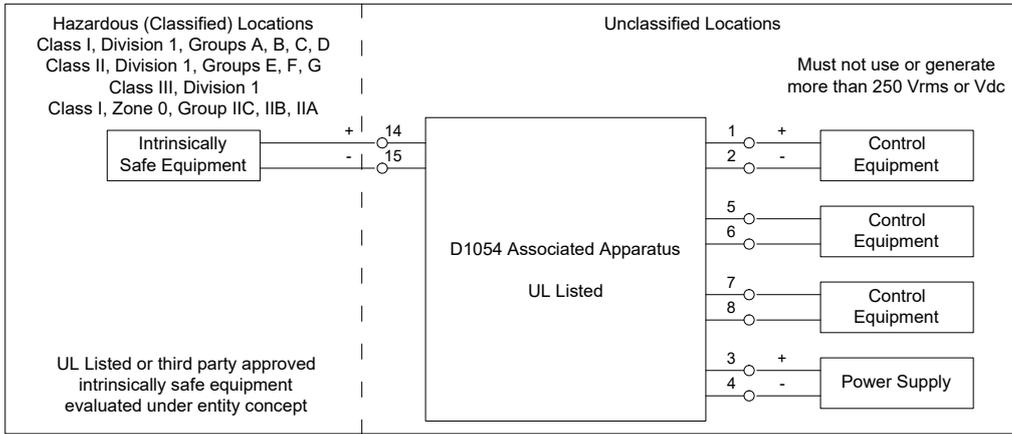

NOTE:

This associated apparatus may also be connected to simple apparatus as defined in Article 504.2 and installed and temperature classified in accordance with article 504.10(B) of the National Electrical Code (ANSI/NFPA 70), or other local codes, as applicable.

This associated apparatus has not been evaluated for use in combination with another associated apparatus.


This associated apparatus provides galvanically isolated intrinsically safe circuits.

D1054 Terminals	Associated Apparatus Parameters	Must be	Hazardous Area/ Hazardous Locations Device Parameters
14 - 15	$U_o / V_{oc} = 26.3 \text{ V}$	\leq	U_i / V_{max}
	$I_o / I_{sc} = 91 \text{ mA}$	\leq	I_i / I_{max}
	$P_o / P_o = 597 \text{ mW}$	\leq	P_i / P_i

The output current of this associated apparatus is limited by a resistor such that the output voltage-current plot is straight line drawn between open-circuit voltage and short-circuit current.

D1054 Terminals	D1054 Associated Apparatus Parameters Zones (Divisions)		Must be	Hazardous Area/ Hazardous Locations Device + Cable Parameters
14 - 15	$C_o / C_a = 95 \text{ nF}$ $C_o / C_a = 738 \text{ nF}$ $C_o / C_a = 2.508 \mu\text{F}$ $C_o / C_a = 738 \text{ nF}$	IIC (A, B) IIB (C) IIA (D) (E, F, G)	\geq	$C_i / C_i \text{ device} + C \text{ cable}$
	$L_o / L_a = 4.3 \text{ mH}$ $L_o / L_a = 17.2 \text{ mH}$ $L_o / L_a = 34.5 \text{ mH}$ $L_o / L_a = 17.2 \text{ mH}$	IIC (A, B) IIB (C) IIA (D) (E, F, G)	\geq	$L_i / L_i \text{ device} + L \text{ cable}$
	$L_o / R_o = 59.6 \mu\text{H}/\Omega$ $L_o / R_o = 238.4 \mu\text{H}/\Omega$ $L_o / R_o = 476.8 \mu\text{H}/\Omega$ $L_o / R_o = 238.4 \mu\text{H}/\Omega$	IIC (A, B) IIB (C) IIA (D) (E, F, G)	\geq	$L_i / R_i \text{ device and } L \text{ cable} / R \text{ cable}$

NOTE: for installations in which both the C_i and L_i of the Intrinsically Safe apparatus exceed 1 % of the C_o and L_o parameters of the Associated Apparatus (excluding the cable), then 50 % of C_o and L_o parameters are applicable and shall not be exceeded (50 % of the C_o and L_o become the limits which must include the cable such that $C_i \text{ device} + C \text{ cable} \leq 50 \% \text{ of } C_o$ and $L_i \text{ device} + L \text{ cable} \leq 50 \% \text{ of } L_o$). The reduced capacitance of the external circuit (including cable) shall not be greater than 1 μF for Groups I, IIA (Group D), IIB (Group C), and 600nF for Group IIC (Group A and B). Capacitance and inductance of the field wiring from the intrinsically safe equipment to the associated apparatus shall be calculated and must be included in the system calculations as shown in the entity parameters table. If the cable parameters are unknown, the following may be used: Capacitance 60pF per foot (180pF per meter), Inductance 0.20 μH per foot (0.60 μH per meter).

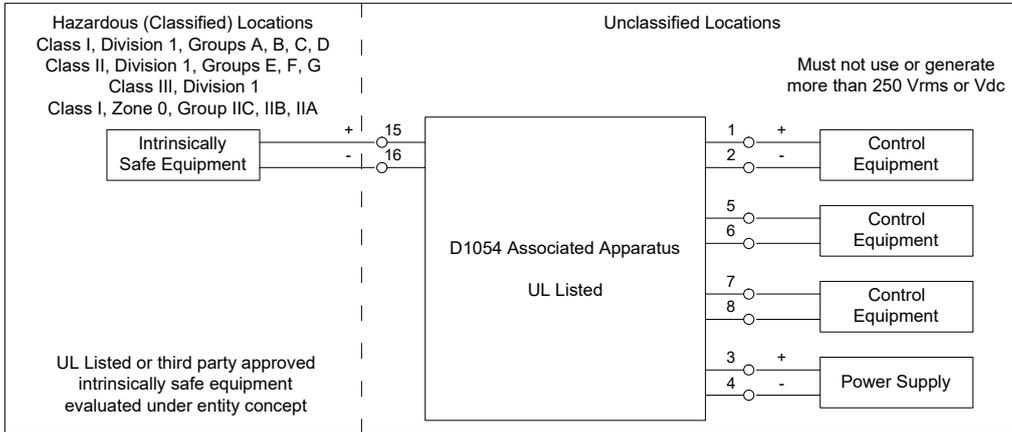

NOTE:

This associated apparatus may also be connected to simple apparatus as defined in Article 504.2 and installed and temperature classified in accordance with article 504.10(B) of the National Electrical Code (ANSI/NFPA 70), or other local codes, as applicable.

This associated apparatus has not been evaluated for use in combination with another associated apparatus.

This associated apparatus provides galvanically isolated intrinsically safe circuits.

D1054 Terminals	Associated Apparatus Parameters	Must be	Hazardous Area/ Hazardous Locations Device Parameters
15 - 16	$U_o / V_{oc} = 1.1 V$	\leq	U_i / V_{max}
	$I_o / I_{sc} = 56 mA$	\leq	I_i / I_{max}
	$P_o / P_o = 16 mW$	\leq	P_i / P_i

The output current of this associated apparatus is limited by a resistor such that the output voltage-current plot is straight line drawn between open-circuit voltage and short-circuit current.

D1054 Terminals	Associated Apparatus Parameters	Must be	Hazardous Area/ Hazardous Locations Device Parameters
15 - 16	$U_i / V_{max} = 30 V$	\geq	U_o / V_{oc}
	$I_i / I_{max} = 128 mA$	\geq	I_o / I_{sc}
	$C_i = 1.05 nF$ $L_i = 0 nH$		

NOTE:

when used with separate powered intrinsically safe devices, check that maximum allowable voltage, current (U_i/V_{max} , I_i/I_{max}) of the D1054 Associated Apparatus are not exceeded by the safety parameters (U_o/V_{oc} , I_o/I_{sc}) of the Intrinsically Safe device.

D1054 Terminals	D1054 Associated Apparatus Parameters Zones (Divisions)	Must be	Hazardous Area/ Hazardous Locations Device + Cable Parameters
15 - 16	$C_o / C_a = 100 \mu F$ $C_o / C_a = 1000 \mu F$ $C_o / C_a = 1000 \mu F$ $C_o / C_a = 1000 \mu F$	\geq	$C_i / C_i \text{ device} + C \text{ cable}$
	$L_o / L_a = 11.3 mH$ $L_o / L_a = 45.3 mH$ $L_o / L_a = 90.7 mH$ $L_o / L_a = 45.3 mH$	\geq	$L_i / L_i \text{ device} + L \text{ cable}$
	$L_o / R_o = 2327 \mu H/\Omega$ $L_o / R_o = 9309 \mu H/\Omega$ $L_o / R_o = 18618 \mu H/\Omega$ $L_o / R_o = 9309 \mu H/\Omega$	\geq	$L_i / R_i \text{ device and } L \text{ cable} / R \text{ cable}$

NOTE: for installations in which both the C_i and L_i of the Intrinsically Safe apparatus exceed 1 % of the C_o and L_o parameters of the Associated Apparatus (excluding the cable), then 50 % of C_o and L_o parameters are applicable and shall not be exceeded (50 % of the C_o and L_o become the limits which must include the cable such that $C_i \text{ device} + C \text{ cable} \leq 50 \% \text{ of } C_o$ and $L_i \text{ device} + L \text{ cable} \leq 50 \% \text{ of } L_o$). The reduced capacitance of the external circuit (including cable) shall not be greater than 1 μF for Groups I, IIA (Group D), IIB (Group C), and 600nF for Group IIC (Group A and B). Capacitance and inductance of the field wiring from the intrinsically safe equipment to the associated apparatus shall be calculated and must be included in the system calculations as shown in the entity parameters table. If the cable parameters are unknown, the following may be used: Capacitance 60pF per foot (180pF per meter), Inductance 0.20 μH per foot (0.60 μH per meter).