




## SAFETY MANUAL

### SIL 3 Switch/Proximity Detector Repeater Relay Output, DIN Rail, Models D5030S, D5030D

Reference must be made to the relevant sections within the instruction manual ISM0106, which contain basic guides for the installation of the equipment.



Application for D5030D (used as double channel, with independent channels)

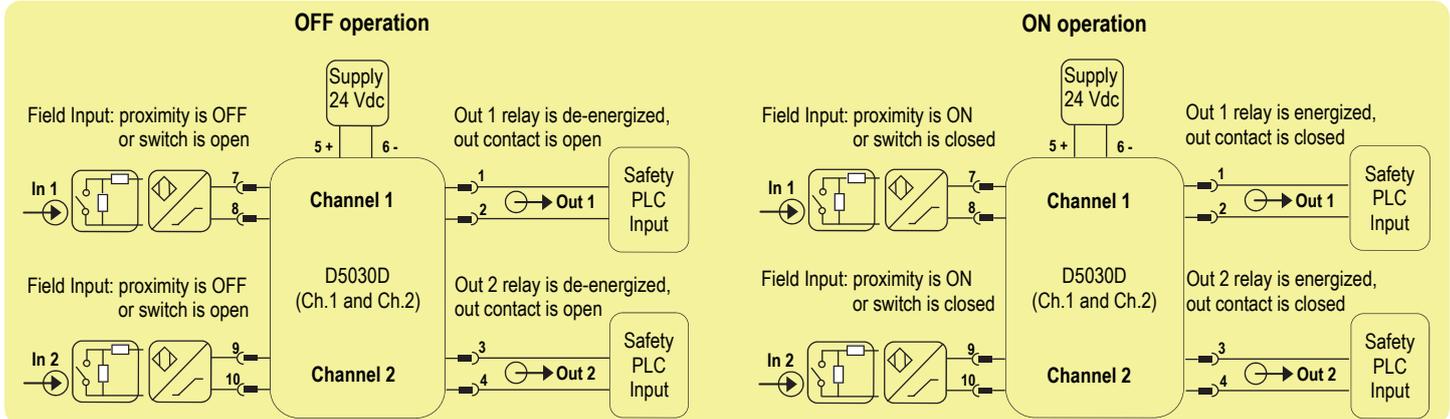

**Description:** For this application, enable input line fault (open or short) detection and direct input to output transfer function, by set the internal dip-switches in the following mode (see pages 7 and 8 for more information):

| Dip-switch position | 1  | 2   | 3  | 4   | 5  | 6   | 7   | 8   |
|---------------------|----|-----|----|-----|----|-----|-----|-----|
| ON/OFF state        | ON | OFF | ON | OFF | ON | OFF | OFF | OFF |

The module is powered by connecting 24 Vdc power supply to Pins 5 (+ positive) - 6 (- negative). The green LED is lit in presence of supply power.

Input signals from field are applied to Pins 7-8 (In 1 - Ch.1) and Pins 9-10 (In 2 - Ch.2).

Relay contact outputs Pins 1-2 (for Channel 1) and Pins 3-4 (for Channel 2) are both normally open (or relay de-energized as safe state condition) for OFF operation, while they are both closed (or relay energized) for ON operation.

The following table describes for each channel the state (open or closed) of its output when its input signal is in OFF or ON state, and it gives information about turn-on or turn-off of the related channel status LED and channel fault LED:

| Input signal state<br>Pins 7-8 (In 1 - Ch.1) or 9-10 (In 2 - Ch.2)                      | Output relay contact state<br>Pins 1-2 (Out 1 - Ch.1) or 3-4 (Out 2 - Ch.2) | Channel status<br>yellow LED state | Channel fault<br>red LED state |
|---|---|------------------------------------|--------------------------------|
| Proximity sensor is OFF or switch is open   | Open (De-energize relay)  | OFF                                | OFF                            |
| Proximity sensor is ON or switch is closed  | Closed (Energized relay)  | ON                                 | OFF                            |
| Independently from proximity sensor or switch state, the input line is break            | Open (De-energized relay as safe state condition)                           | OFF                                | ON                             |
| Independently from proximity sensor or switch state, the input line is in short circuit | Open (De-energized relay as safe state condition)                           | OFF                                | ON                             |

**Safety Function and Failure behavior:**

D5030D is considered to be operating in Low Demand mode, as a Type A module, having Hardware Fault Tolerance (HFT) = 0.

The failure behaviour is described from the following definitions :

- fail-Safe State: it is defined as the relay output is de-energized (NO contact is open);
- fail Safe: failure mode that causes the module to go to the defined fail-safe state without a demand from the process;
- fail Dangerous: failure mode that does not respond to a demand from the process (i.e. being unable to go to the defined fail-safe state), so that the relay output remains energized (NO contact is blocked in closed position);
- fail "No Effect": failure mode of a component that plays a part in implementing the safety function but that is neither a safe failure or a dangerous failure.  
When calculating the SFF this failure mode is not taken into account;
- fail "Not part": failure mode of a component which is not part of the safety function but part of the circuit diagram and is listed for completeness.  
When calculating the SFF this failure mode is not taken into account.

The 2 channels of D5030D module could be used to increase the hardware fault tolerance, needed for a higher SIL of a certain Safety Function, as they are completely independent each other, not containing common components. In fact, the analysis results got for D5030S (single channel) are also valid for each channel of D5030D (double channel).

Failure rate date: taken from Siemens Standard SN29500.

**Failure rate table:**

| Failure category  | Failure rates (FIT)                  |                                   |
|---|--------------------------------------|-----------------------------------|
|   | 100 mA maximum relay contact current | 4 A maximum relay contact current |
| $\lambda_{dd}$ = Total Dangerous Detected failures  | 0.00                                 | 0.00                              |
| $\lambda_{du}$ = Total Dangerous Undetected failures  | 11.22                                | 39.22                             |
| $\lambda_{sd}$ = Total Safe Detected failures   | 0.00                                 | 0.00                              |
| $\lambda_{su}$ = Total Safe Undetected failures   | 101.62                               | 143.62                            |
| <b><math>\lambda_{tot\ safe}</math> = Total Failure Rate (Safety Function) = <math>\lambda_{dd} + \lambda_{du} + \lambda_{sd} + \lambda_{su}</math></b> | <b>112.84</b>                        | <b>182.84</b>                     |
| <b>MTBF (safety function, one channel) = <math>(1 / \lambda_{tot\ safe}) + MTTR</math> (8 hours)</b>  | <b>1011 years</b>                    | <b>624 years</b>                  |
| $\lambda_{no\ effect}$ = "No Effect" failures   | 202.96                               | 202.96                            |
| $\lambda_{not\ part}$ = "Not Part" failures   | 6.20                                 | 6.20                              |
| <b><math>\lambda_{tot\ device}</math> = Total Failure Rate (Device) = <math>\lambda_{tot\ safe} + \lambda_{no\ effect} + \lambda_{not\ part}</math></b> | <b>322.00</b>                        | <b>392.00</b>                     |
| <b>MTBF (device, one channel) = <math>(1 / \lambda_{tot\ device}) + MTTR</math> (8 hours)</b>   | <b>354 years</b>                     | <b>291 years</b>                  |

**Failure rates table according to IEC 61508:2010 Ed.2 :**

| Relay contact current | $\lambda_{sd}$ | $\lambda_{su}$ | $\lambda_{dd}$ | $\lambda_{du}$ | SFF    |
|-----------------------|----------------|----------------|----------------|----------------|--------|
| 100 mA maximum        | 0.00 FIT       | 101.62 FIT     | 0.00 FIT       | 11.22 FIT      | 90.06% |
| 4 A maximum           | 0.00 FIT       | 143.62 FIT     | 0.00 FIT       | 39.22 FIT      | 78.55% |


**PFDavg vs T[Proof] table** (assuming Proof Test coverage of 99%), with determination of SIL supposing module contributes  $\leq 10\%$  of total SIF dangerous failures:

| Relay contact current | T[Proof] = 1 year  |                    |                    | T[Proof] = 20 years                |                                    |
|-----------------------|--------------------|--------------------|--------------------|------------------------------------|------------------------------------|
|                       | PFDavg = 4.92 E-05 | PFDavg = 9.84 E-05 | PFDavg = 9.84 E-04 | T[Proof] = 1 year                  | T[Proof] = 5 years                 |
| 100 mA max            | Valid for SIL 3    | Valid for SIL 3    | Valid for SIL 2    | PFDavg = 1.72 E-04 Valid for SIL 2 | PFDavg = 8.60 E-04 Valid for SIL 2 |

**PFDavg vs T[Proof] table** (assuming Proof Test coverage of 99%), with determination of SIL supposing module contributes  $> 10\%$  of total SIF dangerous failures:

| Relay contact current | T[Proof] = 10 years                | T[Proof] = 20 years                |
|-----------------------|------------------------------------|------------------------------------|
| 100 mA max            | PFDavg = 4.92 E-04 Valid for SIL 3 | PFDavg = 3.44 E-03 Valid for SIL 2 |

Systematic capability SIL 3.

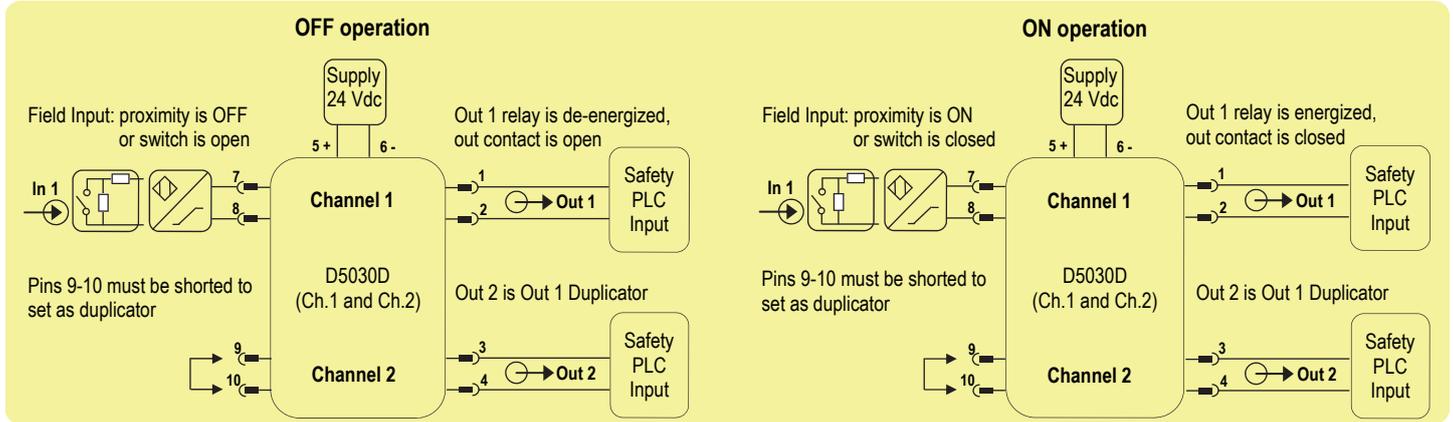

**Description:**

To enable input line fault (open or short) detection on In 1, direct input to output transfer and Out 1 Duplicator functionality (with Parallel mode) on channel 2, set the internal dip-switches in the following mode (see pages 7 and 9 for more information):

| Dip-switch position | 1  | 2   | 3   | 4   | 5  | 6  | 7   | 8  |
|---------------------|----|-----|-----|-----|----|----|-----|----|
| ON/OFF state        | ON | OFF | OFF | OFF | ON | ON | OFF | ON |

The module is powered by connecting 24 Vdc power supply to Pins 5 (+ positive) - 6 (- negative). The green LED is lit in presence of supply power.

Input signal from field is only applied to Pins 7-8 (In 1 - Ch.1). Pins 9-10 must be shorted to set the module as duplicator.

Relay contact outputs Pins 1-2 (for Ch.1) and Pins 3-4 (for Ch.2) are normally open (or de-energized relays as safe state condition) for OFF operation, while they are closed (or energized relays) for ON operation.

The following table describes for Ch.1 and Ch.2 the output state (open or closed) when Ch.1 input signal is in OFF or ON state, and it gives information about turn-on or turn-off of channel status LED and channel fault LED:

| Input 1 signal state<br>Pins 7-8 (In 1 - Ch.1) | Out 1 relay contact state<br>Pins 1-2 (Out 1 - Ch.1) | Out 2 relay contact state<br>Pins 3-4 (Out 1 Duplicator) | Ch.1 or Ch.2 status<br>yellow LED state | Ch.1 or Ch.2 fault<br>red LED state |
|--|--|--|---|-------------------------------------|
| Proximity is OFF or switch is open             | Open (De-energize relay)                             | Open (De-energize relay)                                 | OFF                                     | OFF                                 |
| Proximity is ON or switch is closed            | Closed (Energized relay)                             | Closed (Energized relay)                                 | ON                                      | OFF                                 |
| If the input line is break                     | Open (safe state condition)                          | Open (safe state condition)                              | OFF                                     | ON                                  |
| If the input line is in short circuit          | Open (safe state condition)                          | Open (safe state condition)                              | OFF                                     | ON                                  |

**Safety Function and Failure behavior:**

D5030D is considered to be operating in Low Demand mode, as a Type A module, having Hardware Fault Tolerance (HFT) = 0.

The failure behaviour is described from the following definitions :

- fail-Safe State: it is defined as the relay output is de-energized (NO contact is open);
- fail Safe: failure mode that causes the module to go to the defined fail-safe state without a demand from the process;
- fail Dangerous: failure mode that does not respond to a demand from the process (i.e. being unable to go to the defined fail-safe state), so that the relay output remains energized (NO contact is blocked in closed position);
- fail "No Effect": failure mode of a component that plays a part in implementing the safety function but that is neither a safe failure or a dangerous failure.  
When calculating the SFF this failure mode is not taken into account;
- fail "Not part": failure mode of a component which is not part of the safety function but part of the circuit diagram and is listed for completeness.  
When calculating the SFF this failure mode is not taken into account.

Both channels Ch.1 and Ch.2 (as Ch.1 duplicator) are functional safety related.

Failure rate date: taken from Siemens Standard SN29500.

**Failure rate table:**

| Failure category   | Failure rates (FIT)                  |                                   |
|--|--------------------------------------|-----------------------------------|
|  | 100 mA maximum relay contact current | 4 A maximum relay contact current |
| $\lambda_{dd}$ = Total Dangerous Detected failures   | 0.00                                 | 0.00                              |
| $\lambda_{du}$ = Total Dangerous Undetected failures   | 11.30                                | 39.30                             |
| $\lambda_{sd}$ = Total Safe Detected failures  | 0.00                                 | 0.00                              |
| $\lambda_{su}$ = Total Safe Undetected failures  | 153.95                               | 195.95                            |
| $\lambda_{tot\ safe}$ = Total Failure Rate (Safety Function) = $\lambda_{dd} + \lambda_{du} + \lambda_{sd} + \lambda_{su}$ | <b>165.25</b>                        | <b>235.25</b>                     |
| <b>MTBF (safety function, for each channel) = <math>(1 / \lambda_{tot\ safe}) + MTTR</math> (8 hours)</b>                  | <b>690 years</b>                     | <b>485 years</b>                  |
| $\lambda_{no\ effect}$ = "No Effect" failures  | 398.15                               | 398.15                            |
| $\lambda_{not\ part}$ = "Not Part" failures  | 66.00                                | 136.00                            |
| $\lambda_{tot\ device}$ = Total Failure Rate (Device) = $\lambda_{tot\ safe} + \lambda_{no\ effect} + \lambda_{not\ part}$ | <b>629.40</b>                        | <b>769.40</b>                     |
| <b>MTBF (device) = <math>(1 / \lambda_{tot\ device}) + MTTR</math> (8 hours)</b>   | <b>181 years</b>                     | <b>148 years</b>                  |

**Failure rates table according to IEC 61508:2010 Ed.2 :**

| Relay contact current | $\lambda_{sd}$ | $\lambda_{su}$ | $\lambda_{dd}$ | $\lambda_{du}$ | SFF    |
|-----------------------|----------------|----------------|----------------|----------------|--------|
| 100 mA maximum        | 0.00 FIT       | 153.95 FIT     | 0.00 FIT       | 11.30 FIT      | 93.16% |
| 4 A maximum           | 0.00 FIT       | 195.95 FIT     | 0.00 FIT       | 39.30 FIT      | 83.30% |

**PFDavg vs T[Proof] table** (assuming Proof Test coverage of 99%), with determination of SIL supposing module contributes  $\leq 10\%$  of total SIF dangerous failures:


| Relay contact current | T[Proof] = 1 year  |                    |                    | T[Proof] = 20 years                |                                    |
|-----------------------|--------------------|--------------------|--------------------|------------------------------------|------------------------------------|
|                       | PFDavg = 4.96 E-05 | PFDavg = 9.92 E-05 | PFDavg = 9.92 E-04 | PFDavg = 1.72 E-04 Valid for SIL 2 | PFDavg = 8.62 E-04 Valid for SIL 2 |
| 100 mA max            | Valid for SIL 3    | Valid for SIL 3    | Valid for SIL 2    |                                    |                                    |

**PFDavg vs T[Proof] table** (assuming Proof Test coverage of 99%), with determination of SIL supposing module contributes  $> 10\%$  of total SIF dangerous failures:

| Relay contact current | T[Proof] = 10 years                |  | T[Proof] = 20 years                |  |
|-----------------------|------------------------------------|--|------------------------------------|--|
|                       | PFDavg = 4.96 E-04 Valid for SIL 3 |  | PFDavg = 3.45 E-03 Valid for SIL 2 |  |
| 100 mA max            |                                    |  |                                    |  |

**Systematic capability SIL 3.**

Application for D5030D (used as fault indicator)

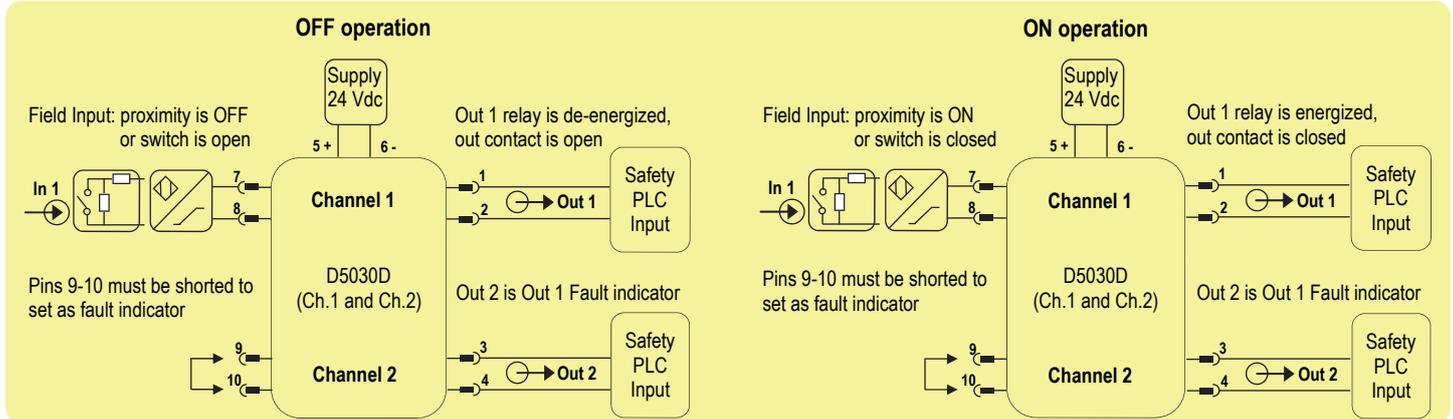

**Description:**

To enable input line fault (open or short) detection on In 1, direct input to output transfer and Out 1 Fault indicator functionality (with NE mode) on channel 2, set the internal dip-switches in the following mode (see pages 7 and 9 for more information):

| Dip-switch position | 1  | 2   | 3   | 4   | 5  | 6   | 7  | 8   |
|---------------------|----|-----|-----|-----|----|-----|----|-----|
| ON/OFF state        | ON | OFF | OFF | OFF | ON | OFF | ON | OFF |

The module is powered by connecting 24 Vdc power supply to Pins 5 (+ positive) - 6 (- negative). The green LED is lit in presence of supply power.

Input signal from field is only applied to Pins 7-8 (In 1 - Ch.1). Pins 9-10 must be shorted to set the module as fault indicator.

Relay contact output Pins 1-2 (for Ch.1) is normally open (or de-energized relay as safe state condition) for OFF operation, while it is closed (or energized relay) for ON operation. Relay contact output Pins 3-4 (for Ch.2) is related to Ch.1 Fault condition: without fault Out 2 is closed (or energized relay); in case of fault Out 2 is open (or de-energized relay as safe state condition). The following table describes for Ch.1 and Ch.2 the output state (open or closed) when Ch.1 input signal is in OFF or ON state, and it gives information about turn-on or turn-off of channel status LED and channel fault LED:

| Input 1 signal state<br>Pins 7-8 (In 1 - Ch.1) | Out 1 relay contact state<br>Pins 1-2 (Out 1 - Ch.1) | Out 2 relay contact state<br>Pins 3-4 (Out 1 Fault indicator) | Ch.1 status<br>yellow LED state | Ch.1 fault<br>red LED state | Ch.2 status<br>yellow LED state |
|--|--|---|---------------------------------|-----------------------------|---------------------------------|
| Proximity is OFF or switch is open             | Open (De-energize relay)                             | Closed (Energized relay)                                      | OFF                             | OFF                         | ON                              |
| Proximity is ON or switch is closed            | Closed (Energized relay)                             | Closed (Energized relay)                                      | ON                              | OFF                         | ON                              |
| If the input line is break                     | Open (safe state condition)                          | Open (safe state condition)                                   | OFF                             | ON                          | OFF                             |
| If the input line is in short circuit          | Open (safe state condition)                          | Open (safe state condition)                                   | OFF                             | ON                          | OFF                             |

**Safety Function and Failure behavior:**

D5030D is considered to be operating in Low Demand mode, as a Type A module, having Hardware Fault Tolerance (HFT) = 0.

The failure behaviour is described from the following definitions :

- fail-Safe State: it is defined as the relay output is de-energized (NO contact is open);
- fail Safe: failure mode that causes the module to go to the defined fail-safe state without a demand from the process;
- fail Dangerous: failure mode that does not respond to a demand from the process (i.e. being unable to go to the defined fail-safe state), so that the relay output remains energized (NO contact is blocked in closed position);
- fail "No Effect": failure mode of a component that plays a part in implementing the safety function but that is neither a safe failure or a dangerous failure. When calculating the SFF this failure mode is not taken into account;
- fail "Not part": failure mode of a component which is not part of the safety function but part of the circuit diagram and is listed for completeness. When calculating the SFF this failure mode is not taken into account.

Both channels Ch.1 and Ch.2 (as Ch.1 fault indicator) are functional safety related.

Failure rate date: taken from Siemens Standard SN29500.

**Failure rate table (Out 1):**

| Failure category   | Failure rates (FIT)                         |  |
|--|---|--|
|  | Out 1: 100 mA maximum relay contact current | Out 1: 4 A maximum relay contact current |
| $\lambda_{dd}$ = Total Dangerous Detected failures   | 0.00  | 0.00                                     |
| $\lambda_{du}$ = Total Dangerous Undetected failures   | 11.30                                       | 39.30                                    |
| $\lambda_{sd}$ = Total Safe Detected failures  | 0.00  | 0.00                                     |
| $\lambda_{su}$ = Total Safe Undetected failures  | 153.95                                      | 195.95                                   |
| $\lambda_{tot\ safe}$ = Total Failure Rate (Safety Function) = $\lambda_{dd} + \lambda_{du} + \lambda_{sd} + \lambda_{su}$ | <b>165.25</b>                               | <b>235.25</b>                            |
| <b>MTBF (safety function, for In1 + Out1) = <math>(1 / \lambda_{tot\ safe}) + MTTR</math> (8 hours)</b>                    | <b>690 years</b>                            | <b>485 years</b>                         |
| $\lambda_{no\ effect}$ = "No Effect" failures  | 398.15                                      | 398.15                                   |
| $\lambda_{not\ part}$ = "Not Part" failures  | 66.00                                       | 136.00                                   |
| $\lambda_{tot\ device}$ = Total Failure Rate (Device) = $\lambda_{tot\ safe} + \lambda_{no\ effect} + \lambda_{not\ part}$ | <b>629.40</b>                               | <b>769.40</b>                            |
| <b>MTBF (device) = <math>(1 / \lambda_{tot\ device}) + MTTR</math> (8 hours)</b>   | <b>181 years</b>                            | <b>148 years</b>                         |

**Failure rates table (Out 1) according to IEC 61508:2010 Ed.2 :**

| Out 1       | Relay contact current | $\lambda_{sd}$ | $\lambda_{su}$ | $\lambda_{dd}$ | $\lambda_{du}$ | SFF    |
|-------------|-----------------------|----------------|----------------|----------------|----------------|--------|
|             | 100 mA maximum        | 0.00 FIT       | 153.95 FIT     | 0.00 FIT       | 11.30 FIT      | 93.16% |
| 4 A maximum | 0.00 FIT              | 195.95 FIT     | 0.00 FIT       | 39.30 FIT      | 83.30%         |        |

**PFDavg vs T[Proof] table (Out 1)** (assuming Proof Test coverage of 99%), with determination of SIL supposing module contributes  $\leq 10\%$  of total SIF dangerous failures:

| Out 1: Relay contact current<br>100 mA max | T[Proof] = 1 year                     |                                       |                                       | T[Proof] = 20 years                |                                    |
|--|---------------------------------------|---------------------------------------|---------------------------------------|------------------------------------|------------------------------------|
|  | PFDavg = 4.96 E-05<br>Valid for SIL 3 | PFDavg = 9.92 E-05<br>Valid for SIL 3 | PFDavg = 9.92 E-04<br>Valid for SIL 2 | PFDavg = 1.72 E-04 Valid for SIL 2 | PFDavg = 8.62 E-04 Valid for SIL 2 |

**PFDavg vs T[Proof] table (Out 1)** (assuming Proof Test coverage of 99%), with determination of SIL supposing module contributes  $> 10\%$  of total SIF dangerous failures:

| Out 1: Relay contact current<br>100 mA max | T[Proof] = 10 years                |  | Out 1: Relay contact current<br>4A max | T[Proof] = 20 years                |  |
|--|------------------------------------|--|--|------------------------------------|--|
|  | PFDavg = 4.96 E-04 Valid for SIL 3 |  |  | PFDavg = 3.45 E-03 Valid for SIL 2 |  |

**Systematic capability SIL 3 for Out 1.**

Failure rate table (Out 2):

| Failure category   | Failure rates (FIT)                         |  |
|--|---|--|
|  | Out 2: 100 mA maximum relay contact current | Out 2: 4 A maximum relay contact current |
| $\lambda_{dd}$ = Total Dangerous Detected failures   | 0.00  | 0.00                                     |
| $\lambda_{du}$ = Total Dangerous Undetected failures   | 10.62                                       | 38.62                                    |
| $\lambda_{sd}$ = Total Safe Detected failures  | 0.00  | 0.00                                     |
| $\lambda_{su}$ = Total Safe Undetected failures  | 153.41                                      | 195.41                                   |
| $\lambda_{tot\ safe}$ = Total Failure Rate (Safety Function) = $\lambda_{dd} + \lambda_{du} + \lambda_{sd} + \lambda_{su}$ | <b>164.03</b>                               | <b>234.02</b>                            |
| <b>MTBF (safety function, for In1 + Out2) = (1 / <math>\lambda_{tot\ safe}</math>) + MTTR (8 hours)</b>                    | <b>696 years</b>                            | <b>487 years</b>                         |
| $\lambda_{no\ effect}$ = "No Effect" failures  | 399.38                                      | 399.38                                   |
| $\lambda_{not\ part}$ = "Not Part" failures  | 66.00                                       | 136.00                                   |
| $\lambda_{tot\ device}$ = Total Failure Rate (Device) = $\lambda_{tot\ safe} + \lambda_{no\ effect} + \lambda_{not\ part}$ | <b>629.41</b>                               | <b>769.40</b>                            |
| <b>MTBF (device) = (1 / <math>\lambda_{tot\ device}</math>) + MTTR (8 hours)</b>   | <b>181 years</b>                            | <b>148 years</b>                         |

Failure rates table (Out 2) according to IEC 61508:2010 Ed.2 :

| Out 2 | Relay contact current | $\lambda_{sd}$ | $\lambda_{su}$ | $\lambda_{dd}$ | $\lambda_{du}$ | SFF    |
|-------|-----------------------|----------------|----------------|----------------|----------------|--------|
|       | 100 mA maximum        | 0.00 FIT       | 153.41 FIT     | 0.00 FIT       | 10.62 FIT      | 93.53% |
|       | 4 A maximum           | 0.00 FIT       | 195.41 FIT     | 0.00 FIT       | 38.62 FIT      | 83.50% |

PFDavg vs T[Proof] table (Out 2) (assuming Proof Test coverage of 99%), with determination of SIL supposing module contributes  $\leq 10\%$  of total SIF dangerous failures:


| Out 2: Relay contact current | T[Proof] = 1 year | T[Proof] = 2 years                    | T[Proof] = 20 years                   | Out 2: Relay contact current | T[Proof] = 1 year                     | T[Proof] = 5 years |
|------------------------------|-------------------|---------------------------------------|---------------------------------------|------------------------------|---------------------------------------|--------------------|
|                              | 100 mA max        | PFDavg = 4.66 E-05<br>Valid for SIL 3 | PFDavg = 9.32 E-05<br>Valid for SIL 3 |                              | PFDavg = 9.32 E-04<br>Valid for SIL 2 | 4A max             |

PFDavg vs T[Proof] table (Out 2) (assuming Proof Test coverage of 99%), with determination of SIL supposing module contributes  $> 10\%$  of total SIF dangerous failures:

| Out 2: Relay contact current | T[Proof] = 10 years | Out 2: Relay contact current | T[Proof] = 20 years                |
|------------------------------|---------------------|------------------------------|------------------------------------|
|                              | 100 mA max          |                              | PFDavg = 4.66 E-04 Valid for SIL 3 |

Systematic capability SIL 3 for Out 2.

Application for D5030S

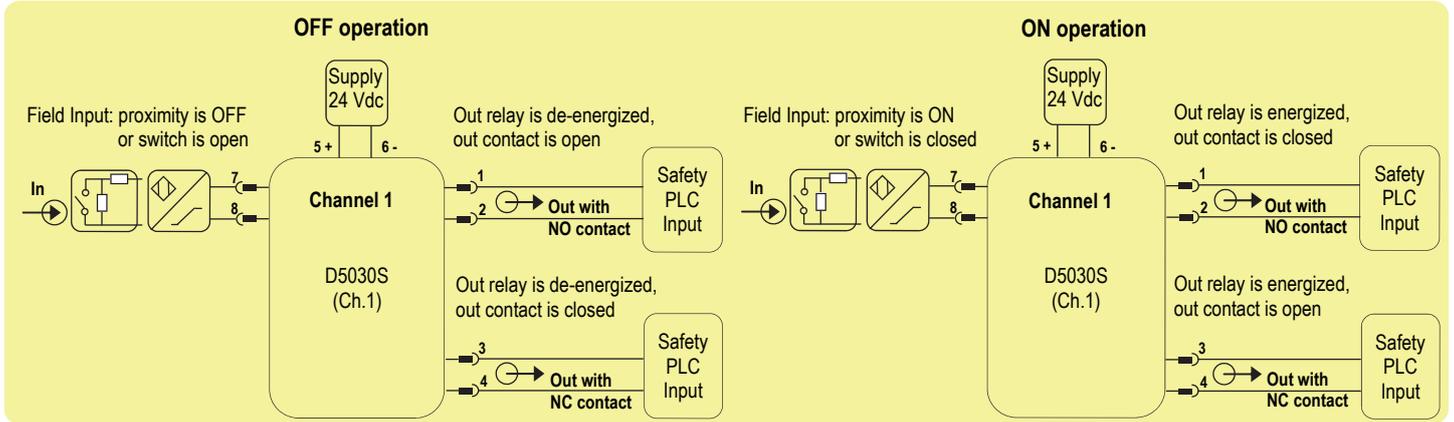

**Description:**

For this application, enable input line fault (open or short) detection and direct input to output transfer function, by set the internal dip-switches in the following mode (see page 10 for more information):

| Dip-switch position | 1  | 2   | 3        | 4        | 5  | 6        | 7   | 8   |
|---------------------|----|-----|----------|----------|----|----------|-----|-----|
| ON/OFF state        | ON | OFF | Not used | Not used | ON | Not used | OFF | OFF |

The module is powered by connecting 24 Vdc power supply to Pins 5 (+ positive) - 6 (- negative). The green LED is lit in presence of supply power.

Input signal from field is applied to Pins 7-8 (In - Ch.1).

Relay contact output Pins 1-2 is normally open or Pins 3-4 is normally closed (because relay is de-energized as safe state condition) for OFF operation, while Pins 1-2 is closed or Pins 3-4 is open (because relay is energized) for ON operation. The following table describes for Channel 1 the state (open or closed) of its output contacts when its input signal is in OFF or ON state, and it gives information about turn-on or turn-off of its channel status LED and channel fault LED:

| Input signal state<br>Pins 7-8        | Out relay contact state<br>Pins 1-2 (with NO contact) | Out relay contact state<br>Pins 3-4 (with NC contact) | Channel status<br>yellow LED state | Channel fault<br>red LED state |
|---------------------------------------|---|---|------------------------------------|--------------------------------|
| Proximity is OFF or switch is open    | Open (De-energize relay)                              | Closed (De-energize relay)                            | OFF                                | OFF                            |
| Proximity is ON or switch is closed   | Closed (Energized relay)                              | Open (Energized relay)                                | ON                                 | OFF                            |
| If the input line is break            | Open (safe state condition)                           | Closed (safe state condition)                         | OFF                                | ON                             |
| If the input line is in short circuit | Open (safe state condition)                           | Closed (safe state condition)                         | OFF                                | ON                             |

**Safety Function and Failure behavior:**

D5030S is considered to be operating in Low Demand mode, as a Type A module, having Hardware Fault Tolerance (HFT) = 0.

The failure behaviour is described from the following definitions :

- fail-Safe State: it is defined as the relay output is de-energized (NO contact is open or NC contact is closed);
- fail Safe: failure mode that causes the module to go to the defined fail-safe state without a demand from the process;
- fail Dangerous: failure mode that does not respond to a demand from the process (i.e. being unable to go to the defined fail-safe state), so that the relay output remains energized (NO contact is blocked in closed position or NC contact is blocked in open position);
- fail "No Effect": failure mode of a component that plays a part in implementing the safety function but that is neither a safe failure or a dangerous failure.

When calculating the SFF this failure mode is not taken into account;

- fail "Not part": failure mode of a component which is not part of the safety function but part of the circuit diagram and is listed for completeness.

When calculating the SFF this failure mode is not taken into account.

Failure rate date: taken from Siemens Standard SN29500.

**Failure rate table:**

| Failure category  | Failure rates (FIT)                  |                                   |
|---|--------------------------------------|-----------------------------------|
|   | 100 mA maximum relay contact current | 4 A maximum relay contact current |
| $\lambda_{dd}$ = Total Dangerous Detected failures  | 0.00                                 | 0.00                              |
| $\lambda_{du}$ = Total Dangerous Undetected failures  | 11.22                                | 39.22                             |
| $\lambda_{sd}$ = Total Safe Detected failures   | 0.00                                 | 0.00                              |
| $\lambda_{su}$ = Total Safe Undetected failures   | 101.62                               | 143.62                            |
| <b><math>\lambda_{tot\ safe}</math> = Total Failure Rate (Safety Function) = <math>\lambda_{dd} + \lambda_{du} + \lambda_{sd} + \lambda_{su}</math></b> | <b>112.84</b>                        | <b>182.84</b>                     |
| <b>MTBF (safety function, channel 1) = <math>(1 / \lambda_{tot\ safe}) + MTTR</math> (8 hours)</b>  | <b>1011 years</b>                    | <b>624 years</b>                  |
| $\lambda_{no\ effect}$ = "No Effect" failures   | 202.96                               | 202.96                            |
| $\lambda_{not\ part}$ = "Not Part" failures   | 6.20                                 | 6.20                              |
| <b><math>\lambda_{tot\ device}</math> = Total Failure Rate (Device) = <math>\lambda_{tot\ safe} + \lambda_{no\ effect} + \lambda_{not\ part}</math></b> | <b>322.00</b>                        | <b>392.00</b>                     |
| <b>MTBF (device, channel 1) = <math>(1 / \lambda_{tot\ device}) + MTTR</math> (8 hours)</b>   | <b>354 years</b>                     | <b>291 years</b>                  |

**Failure rates table according to IEC 61508:2010 Ed.2 :**

| Relay contact current | $\lambda_{sd}$ | $\lambda_{su}$ | $\lambda_{dd}$ | $\lambda_{du}$ | SFF    |
|-----------------------|----------------|----------------|----------------|----------------|--------|
| 100 mA maximum        | 0.00 FIT       | 101.62 FIT     | 0.00 FIT       | 11.22 FIT      | 90.06% |
| 4 A maximum           | 0.00 FIT       | 143.62 FIT     | 0.00 FIT       | 39.22 FIT      | 78.55% |

**PFDavg vs T[Proof] table** (assuming Proof Test coverage of 99%), with determination of SIL supposing module contributes  $\leq 10\%$  of total SIF dangerous failures:

| Relay contact current | T[Proof]                              |                                       |                                       | Relay contact current | T[Proof]                           |                                    |
|-----------------------|---------------------------------------|---------------------------------------|---------------------------------------|-----------------------|------------------------------------|------------------------------------|
|                       | 1 year                                | 2 years                               | 20 years                              |                       | 1 year                             | 5 years                            |
| 100 mA max            | PFDavg = 4.92 E-05<br>Valid for SIL 3 | PFDavg = 9.84 E-05<br>Valid for SIL 3 | PFDavg = 9.84 E-04<br>Valid for SIL 2 | 4A max                | PFDavg = 1.72 E-04 Valid for SIL 2 | PFDavg = 8.60 E-04 Valid for SIL 2 |

**PFDavg vs T[Proof] table** (assuming Proof Test coverage of 99%), with determination of SIL supposing module contributes  $>10\%$  of total SIF dangerous failures:

| Relay contact current | T[Proof]  | Relay contact current | T[Proof]  |
|-----------------------|---|-----------------------|---|
| 100 mA max            | T[Proof] = 10 years<br>PFDavg = 4.92 E-04 Valid for SIL 3 | 4A max                | T[Proof] = 20 years<br>PFDavg = 3.44 E-03 Valid for SIL 2 |

**Systematic capability SIL 3.**

## Testing procedure at T-proof

The proof test shall be performed to reveal dangerous faults which are undetected by diagnostic. This means that it is necessary to specify how dangerous undetected fault, which have been noted during the FMEDA, can be revealed during proof test.

**Note for switch input:** to detect a broken wire, or a short circuit condition, in the input connections it is necessary to mount, close to the switches, the end of line resistors: R1=1 KΩ typical (470 Ω to 2 KΩ range) resistor in series and R2=10 kΩ typical (5 KΩ to 15 KΩ range) resistor in parallel to the contacts.

The Proof test consists of the following steps:

| Steps | Action  |
|-------|---|
| 1     | Bypass the safety-related PLC or take other appropriate action to avoid a false trip.   |
| 2     | Vary the state conditions of the input sensors/contacts coming from field and verify that relay outputs change from de-energized to energized and vice versa, then check that the de-energized state condition corresponds to the required safety-related function.   |
| 3     | If input line fault detection is enable for each channel by means of Dip-switches specific set up, disconnect the input wiring coming from the field sensor/contact and check that the correspondent relay output is de-energized. Then, put in short condition the input connections and verify that the same output remains de-energized. In both case the proper alarm LEDs, on the front panel, will be came red. |
| 4     | Restore the loop to full operation.   |
| 5     | Remove the bypass from the safety-related PLC or restore normal operation.  |

This test will reveal approximately 99 % of possible Dangerous Undetected failures in the repeater.

## Configuration

### DIP Switch factory settings (valid for D5030S and D5030D)

| SW1 | SW2 | SW3 | SW4 | SW5 | SW6 | SW7 | SW8 |
|-----|-----|-----|-----|-----|-----|-----|-----|
| OFF |

### D5030D (used as double channel) Configuration Summary Table : **WARNING:** dip-switch 6-7-8 must be set to "OFF" position.

| Channel  | 1   | 2   | Channel | 1                                       | 2   |     |
|--|-----|-----|---------|---|-----|-----|
| Line fault detection   | SW1 | SW5 | SW3     | IN/OUT Operation                        | SW2 | SW4 |
| Disabled<br>(switch/proximity sensor)  | OFF | OFF | OFF     | NO-NE or NC-ND                          | ON  | ON  |
| Enabled, for SIL application<br>(proximity sensor or switch with end of line resistors,<br>detects field open circuit and short circuit,<br>de-energizes relay in fault condition) | ON  | ON  | ON      | NO-ND or NC-NE<br>(for SIL application) | OFF | OFF |

### D5030D (used as duplicator or fault output) Configuration Summary Table

**WARNING:** Terminals 9-10 must be shorted to set module as Duplicator or Fault Out. Dip-switch 3 must be set to "OFF" position.

| Line fault detection   | SW1   | SW5 | IN/OUT Operation Output 1               | SW2 |
|--|---|-----|---|-----|
| Disabled<br>(switch/proximity sensor)  | OFF   | OFF | NO-NE or NC-ND                          | ON  |
| Enabled, for SIL application<br>(proximity sensor or switch with end of line resistors,<br>detects field open circuit and short circuit,<br>de-energizes relay in fault condition) | Output 1,<br>(for SIL application)<br>De-energized in Fault condition | ON  | NO-ND or NC-NE<br>(for SIL application) | OFF |
|  | Output 1,<br>Not specified Fault condition                            | OFF |   |     |

| Output 2 Operation | SW6  | SW7 | SW8 | Mode                        | SW4                               |                     |
|--------------------|--|-----|-----|-----------------------------|-----------------------------------|---------------------|
| Duplicator         | De-energized in fault condition<br>(for SIL application)<br>if line fault detection enabled (SW1 ON) | ON  | OFF | ON                          | Parallel<br>(for SIL application) | Set equal to SW2    |
|                    | Not specified Fault condition  | OFF |     |                             | Reverse                           | Set opposite to SW2 |
| Fault Output       | OFF<br>(for SIL application)   | ON  | OFF | ND                          | ON                                |                     |
|                    |  |     |     | NE<br>(for SIL application) | OFF                               |                     |


### D5030S Configuration Summary Table : **WARNING:** Dip-switch 7-8 must be set to "OFF" position.

| Line fault detection   | SW1 | SW5 | IN/OUT Operation                        | SW2 |
|--|-----|-----|---|-----|
| Disabled<br>(switch/proximity sensor)  | OFF | OFF | NO-NE or NC-ND                          | ON  |
| Enabled, for SIL application<br>(proximity sensor or switch with end of line resistors,<br>detects field open circuit and short circuit,<br>de-energizes relay in fault condition) | ON  | ON  | NO-ND or NC-NE<br>(for SIL application) | OFF |


**D5030D used as double channel**

A configuration DIP switch is located on component side of pcb. This switch allows the configuration of input/output relationship, fault detection functions and operating mode.



**WARNING:** dip-switch 6-7-8 must be set to "OFF" position.

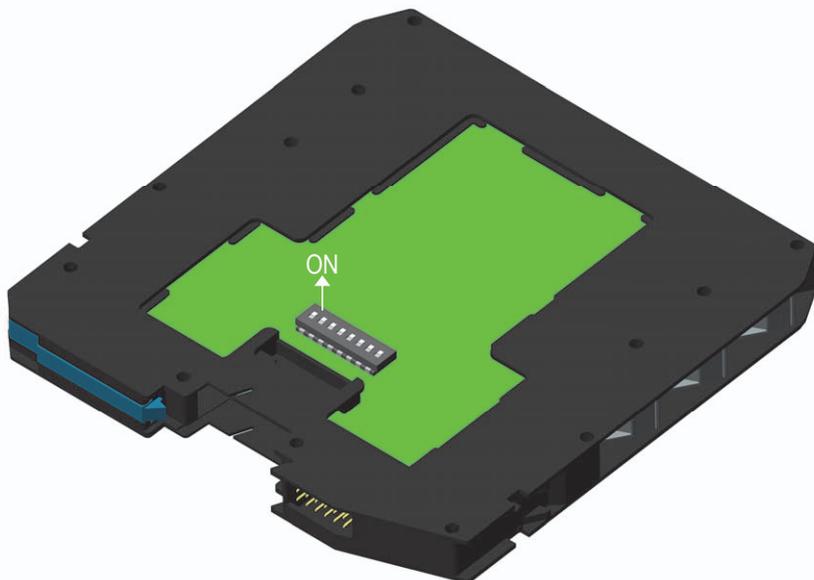

Dip switch factory settings. All Switches are OFF



Dip switch configuration

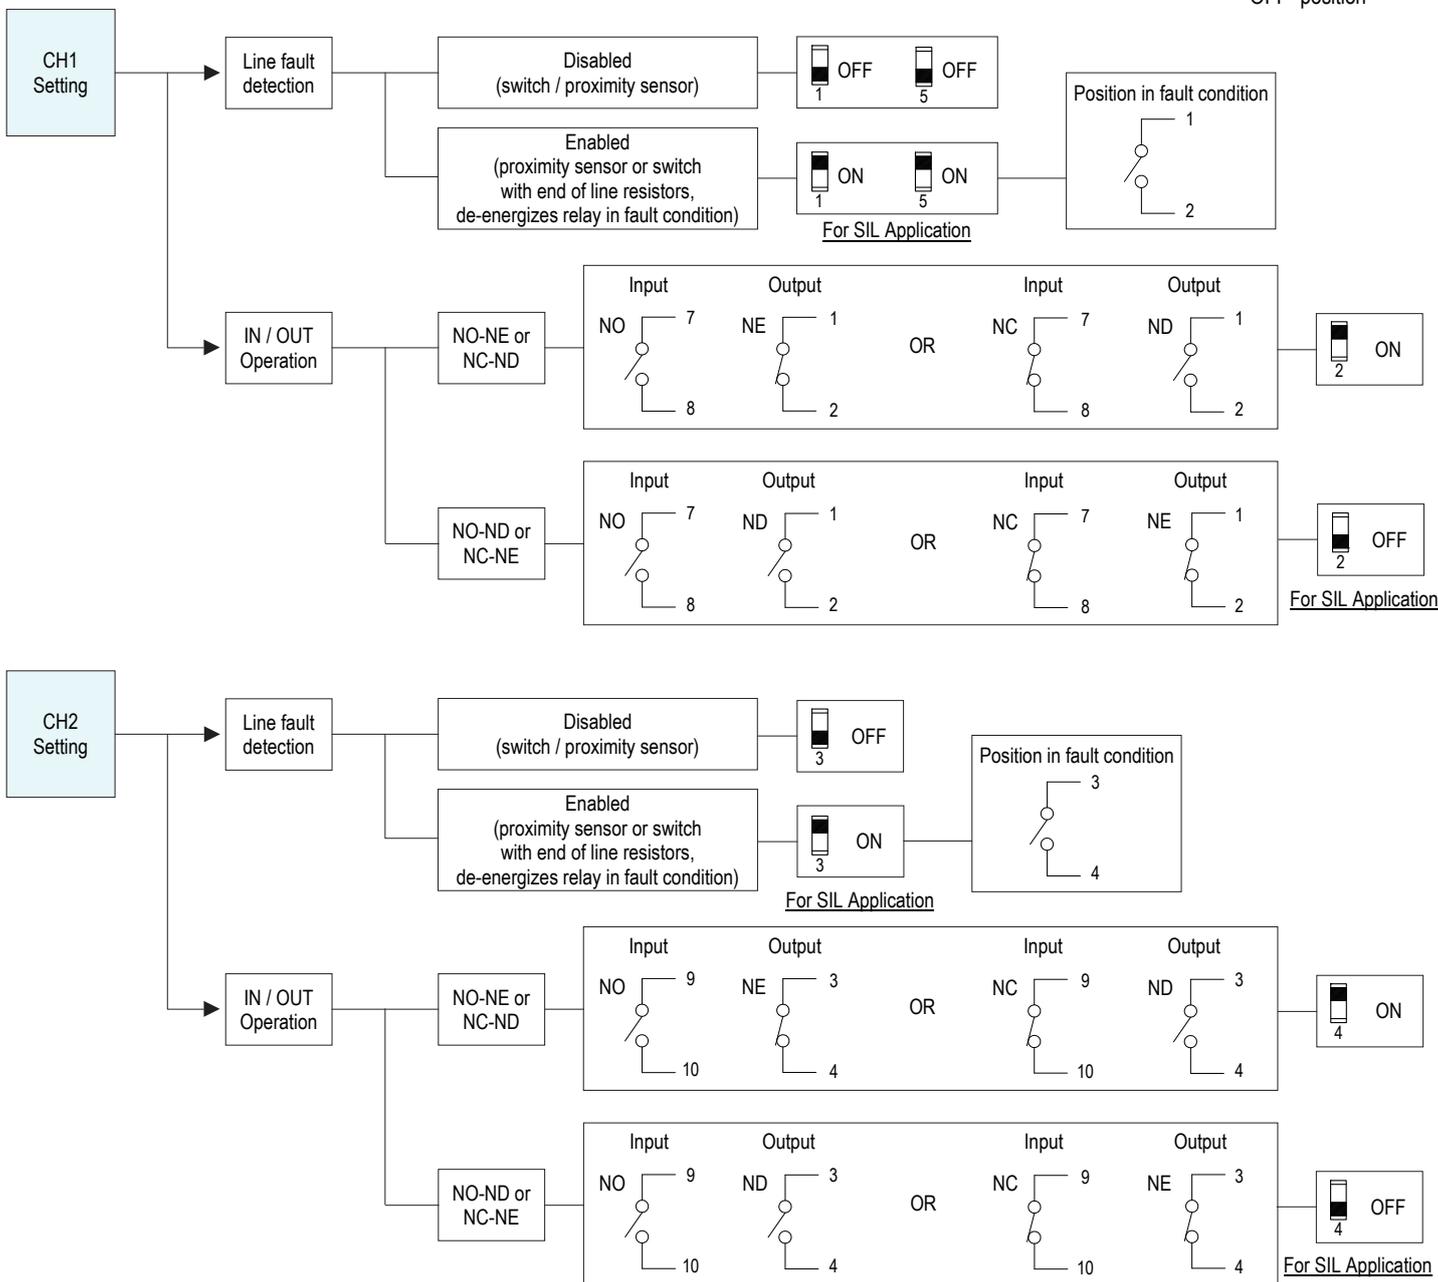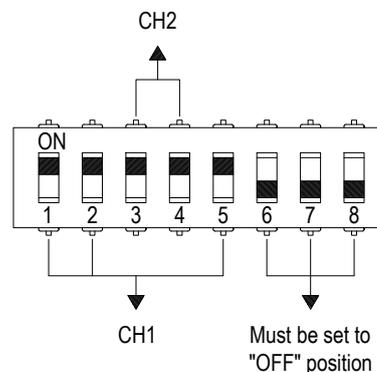


### D5030D used as duplicator or fault output

A configuration DIP switch is located on component side of pcb. This switch allows the configuration of input/output relationship, fault detection functions and operating mode.

**WARNING: Terminals 9-10 must be shorted to set module as Duplicator or Fault Out.**


Dip-switch 3 **must be set to "OFF" position.**

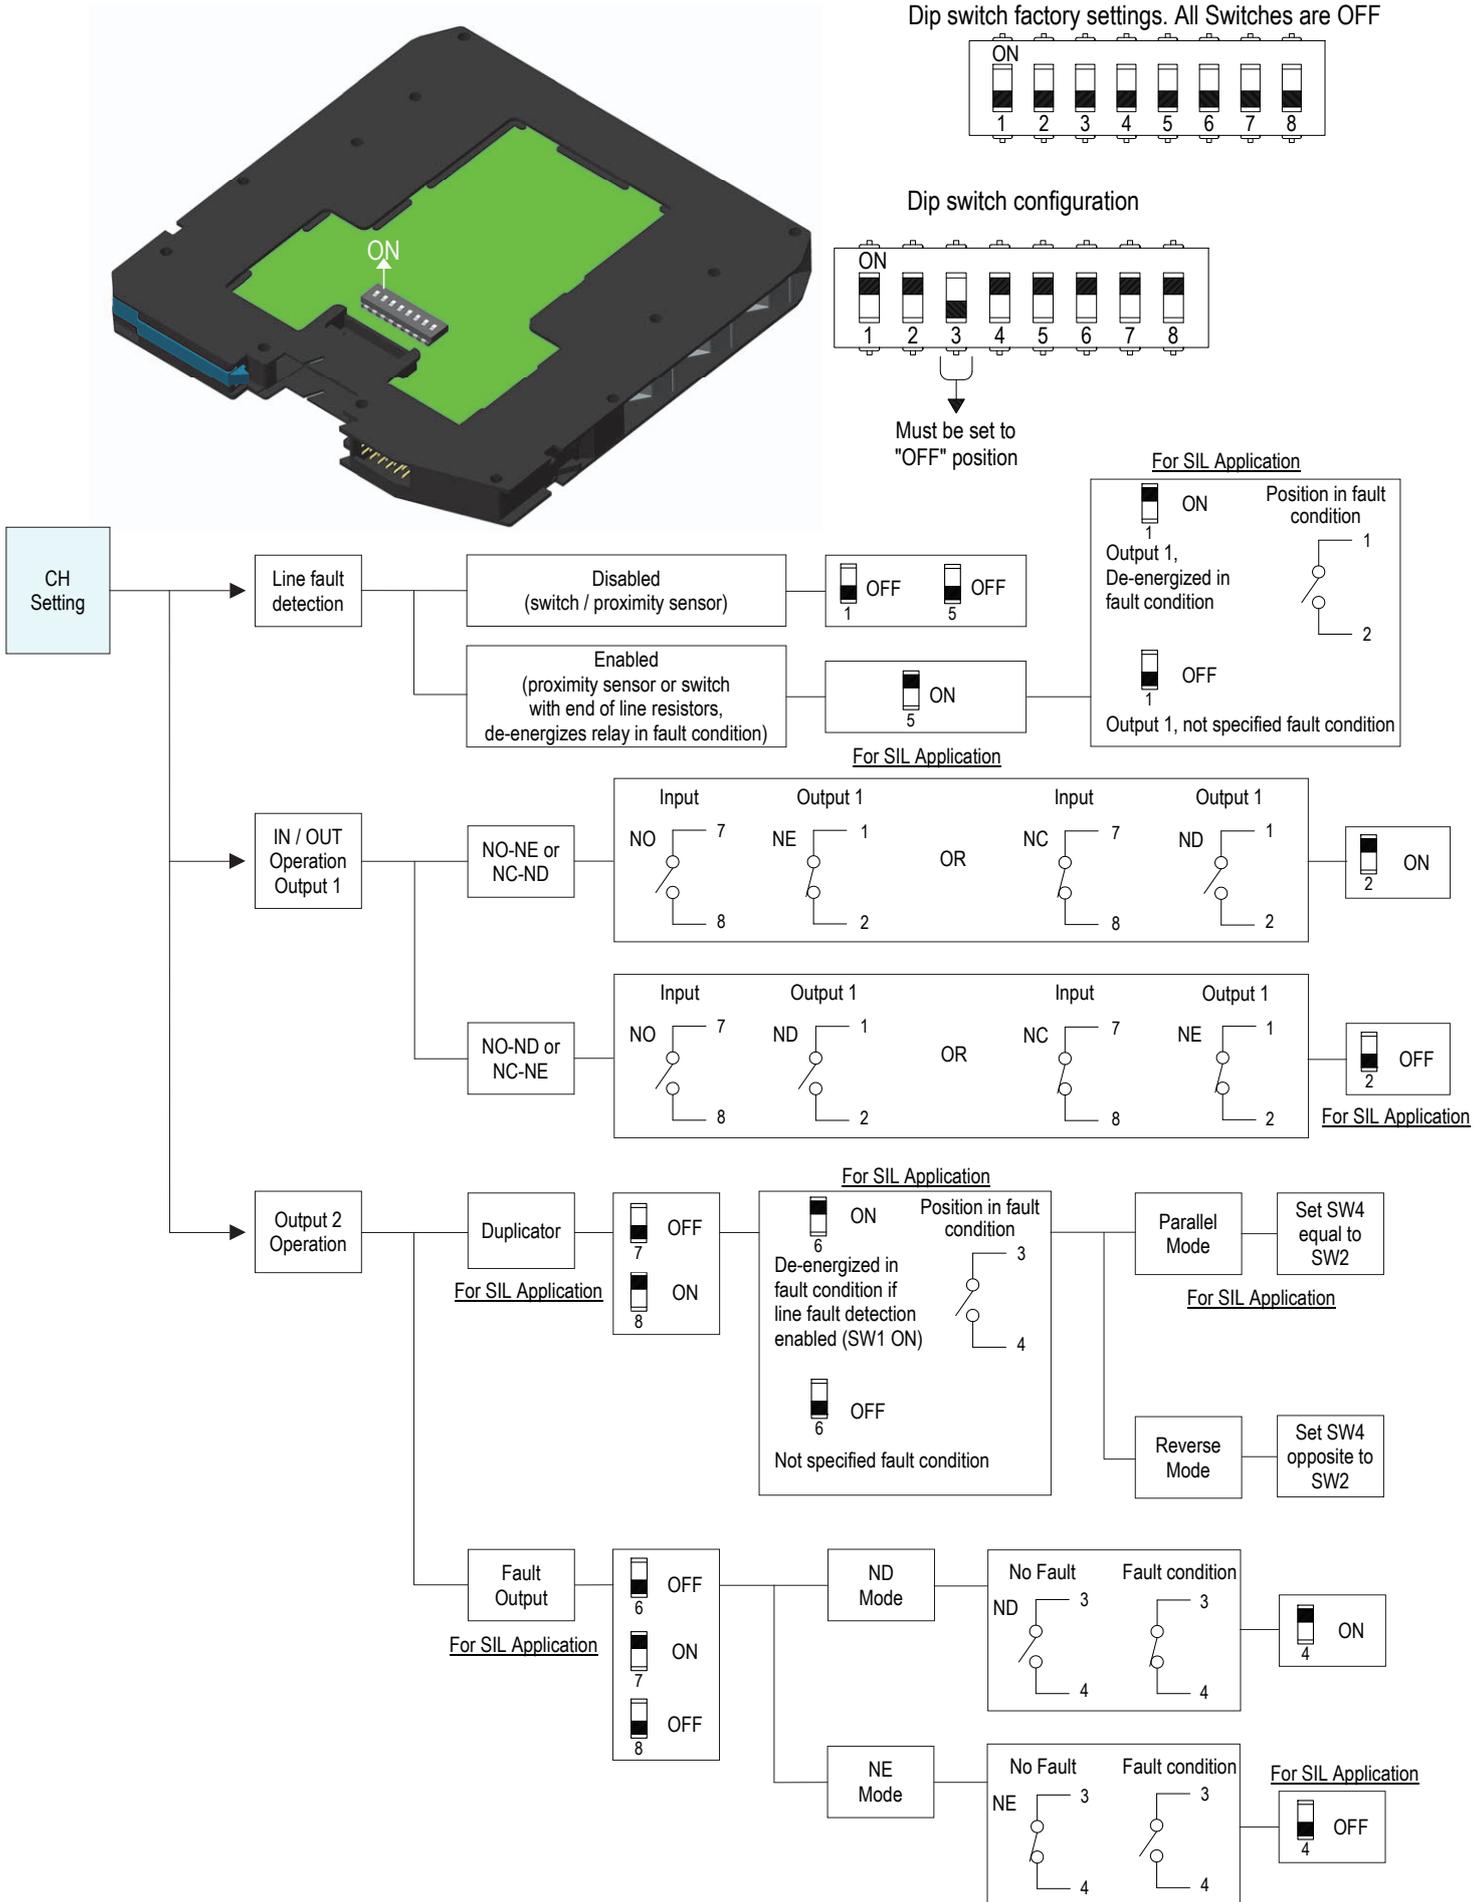


**D5030S**

A configuration DIP switch is located on component side of pcb. This switch allows the configuration of input/output relationship, fault detection functions and operating mode.


**WARNING:** Dip-switch 7-8 must be set to "OFF" position.

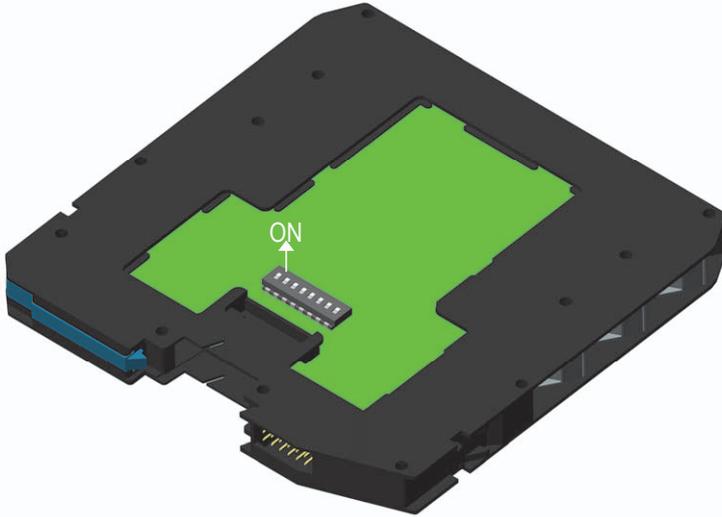

Dip switch factory settings. All Switches are OFF



Dip switch configuration

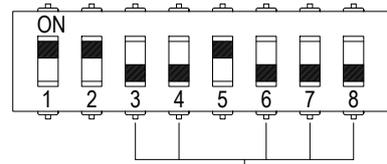

7-8 must be set to "OFF" position  
3-4-6 Not used

