



# Termination Board 16 positions for ABB S800 (TU812, TU819, TU852) with DI card DI814, and DO cards DO810, DO818, DO840, DO880

## **Characteristics:**

## General description:

This Termination Board (TB) provides direct connection between the I/O Card of the system and D5000 / D6000 Series modules.

The Intrinsically Safe protection and signal isolation between Safe and Hazardous Area, is provided by D5000 Series Associated Apparatus. The 24 Vdc Power Supply of the TB is connected to two plug-in terminal blocks, for a redundant power supply. The power supply for modules is given by TB power bus.

#### Termination Board general characteristics:

Number of positions	Features
16	Power Supply voltage redundancy;     Abnormal supply voltage signaling;     Cumulative module fault signaling.

#### Supported ABB S800 I/O Cards:

Supported ADD 6000 NO Gards.						
I/O Card Type	TU Type	I/O Card Model	Channels per I/O Card	TUs per board	Channels per board	Supported GM Modules(*)
Digital In	TU812	DI814	16	1	16	D5031S, D5032S, D5037S, D5093S, D6001S, D6002S, D6031S, D6032S, D6037S
				2	32	D5031D, D5032D, D5037D, D5093D, D6000D, D6001D, D6031D, D6032D, D6037D
	TU812	DO810	16	1	16	D5040S, D5048S, D5049S, D5090S, D5091S, D5094S, D5095S, D5096S, D5096S-100, D5097S, D5098S, D6001S, D6002S
	TU812 TU852	DO840 DO880	16	1		
	TU812	DO810	16	2	32	D5040D, D5098D, D6000D, D6001D
Digital Out	TU812 TU852	DO840 DO880	16	2	32	
	TU819	DO818	32	1/2	16	D5040S, D5048S, D5049S, D5090S, D5091S, D5094S, D5095S, D5096S, D5096S-100, D5097S, D5098S, D6001S, D6002S
				1	32	D5040D, D5098D, D6000D, D6001D

(\*) Do not mix D5000 Intrinsically Safe barriers with D5000 Relay modules or D6000 isolators on same termination board.

#### Features:

- S800 DI and DO Cards board interfaces.
- 16 positions Termination Board for up to 32 channels.
- Lower cables installation and maintenance costs.
- Power supplies fault monitoring.
- · Spare fuse provided.
- Mounting hardware provided for:

Wall mounting, M4 thread screw;

Wall mounting, M4 self tapping screw;

Single Din Rail mounting kit.

## **Ordering Information:**

Model: TB-D5016-ABB-002

## **Technical Data:**

#### Supply:

 $24\ \text{Vdc}$  nom (20 to 30 Vdc) reverse polarity protected, double terminal blocks for redundant power supply, with OR diodes to mix supply voltages.

**Connection:** by polarized plug-in disconnect screw terminal blocks to accommodate terminations up to 2.5 mm<sup>2</sup>.

2 LEDs indication: green color, one for supply 1 and one for supply 2. Protection fuse: 4 A time lag (spare fuse provided on Termination Board).
Fault detection:

- Preventive abnormal supply voltage: supply 1 or supply 2 is < 18 Vdc (Under Voltage, UV) or > 30 Vdc (Over Voltage, OV).
- 2) Critical abnormal supply voltages or cumulative fault: both supplies are in under (< 18 Vdc) or over (> 30 Vdc) voltage condition OR cumulative fault indication (about presence of short or open field circuit for any DO channel).

**LED fault signaling (for both case 1 and 2):** 2 red LEDs (UV and OV of supply 1); 2 red LEDs (UV and OV of supply 2); a cumulative fault red LED.

Relay fault signaling (one for each case 1 or 2): a voltage free NE SPDT - 1 Form C relay contacts (de-energized in fault condition), with the following characteristics:

Contact material: AgCdO.

Contact rating: 2 A 36 Vac 72 VA, 2 A 48 Vdc 80 W (resistive load).

Mechanical / Electrical life: 30 \* 10<sup>6</sup> / 1 \* 10<sup>5</sup> operation, typical.

Coil status LED indication: yellow color, turn on when coil is energized.

Connection: by polarized plug-in disconnect screw terminal blocks to accommodate terminations up to 2.5 mm<sup>2</sup>.

## I/O card interface:

**Connection:** two 25 poles SUB-D male connectors (require female mating connectors). **Maximum current per channel:** 500 mA.

#### Environmental conditions:

**Operating:** temperature limits -40 to +70 °C, relative humidity max 90 % non condensing, up to 35 °C.


Storage: temperature limits – 45 to + 80 °C.

#### Mounting:

Hardware included for mounting on wall and single DIN rail. **Weight:** about 400 g (excluding modules and mounting options). **Location:** Safe Area / Ordinary locations.


Dimensions: Width 267 mm, Depth 176 mm, Height 125 mm.

## Image:

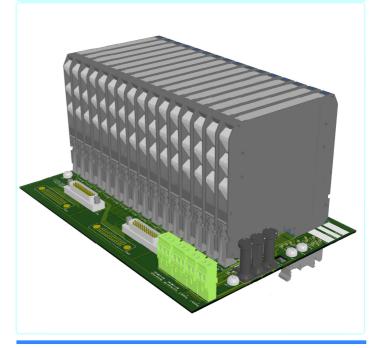



FIELD SAFE AREA Note: Do not mix D5000 Intrinsically Safe barriers with D5000 Relay modules or D6000 isolators on same termination board. TB-D5016-ABB-002 Single channel module TU812 n.1 C O N X 1 I/O Field CARD Channel A Device C O N 2 Supply Fault Termination Board connector 000 Supply Fault TB-D5016-ABB-002 Double channel module TU812 n.1 С χ 1 I/O 0 N Field CARD Channel A Device TU812 n.2 C O N Field Channel B X 1 I/O Device CARD Supply Fault **Termination** Board connector 000 Supply Fault

FIELD SAFE AREA Note: Do not mix D5000 Intrinsically Safe barriers with D5000 Relay modules or D6000 isolators on same termination board. TB-D5016-ABB-002 TU852 n.1 Single channel module I/O CARD В С О X 1 A Field I/O Ν Channel A Device 1 CARD C O N 2 Supply & Fault **Termination** Board connector  $\Diamond$ Supply Fault TB-D5016-ABB-002 TU852 n.1 Double channel module χ 1 I/O CARD В Ŏ N Field X I/O Channel A 1 Device CARD TU852 n.2 C 0 Field Channel B Device N 2 X 1 I/O CARD Supply Α Fault X I/O 1 B CARD Termination Board connector  $\Diamond$ 000 Supply Fault

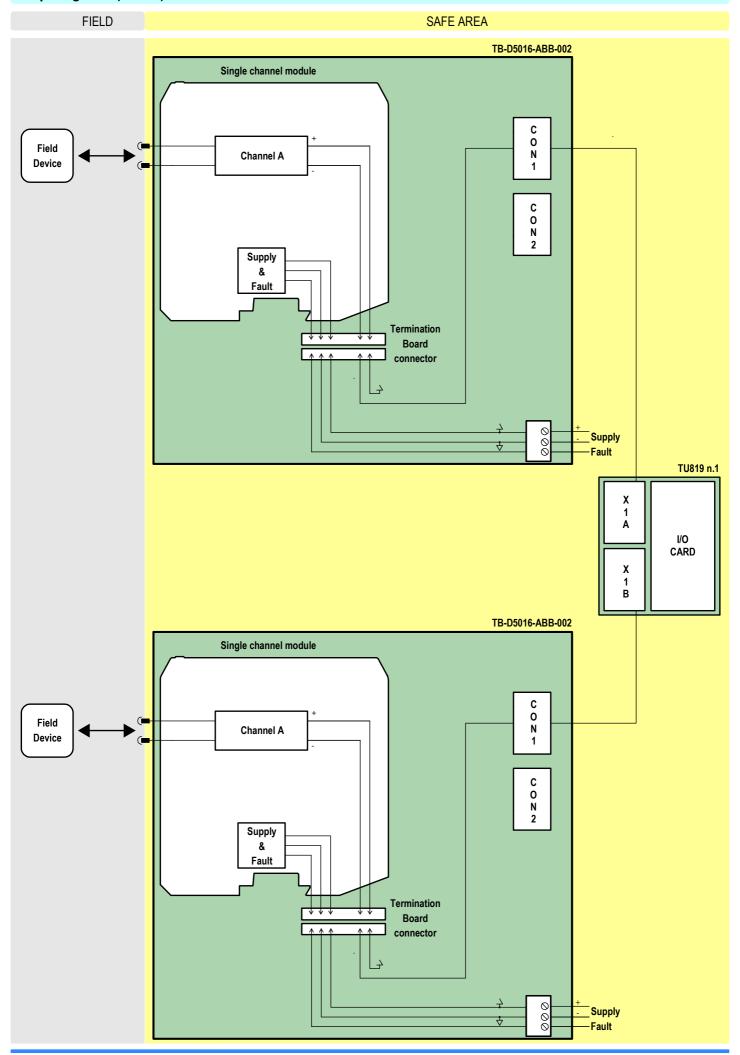

FIELD SAFE AREA

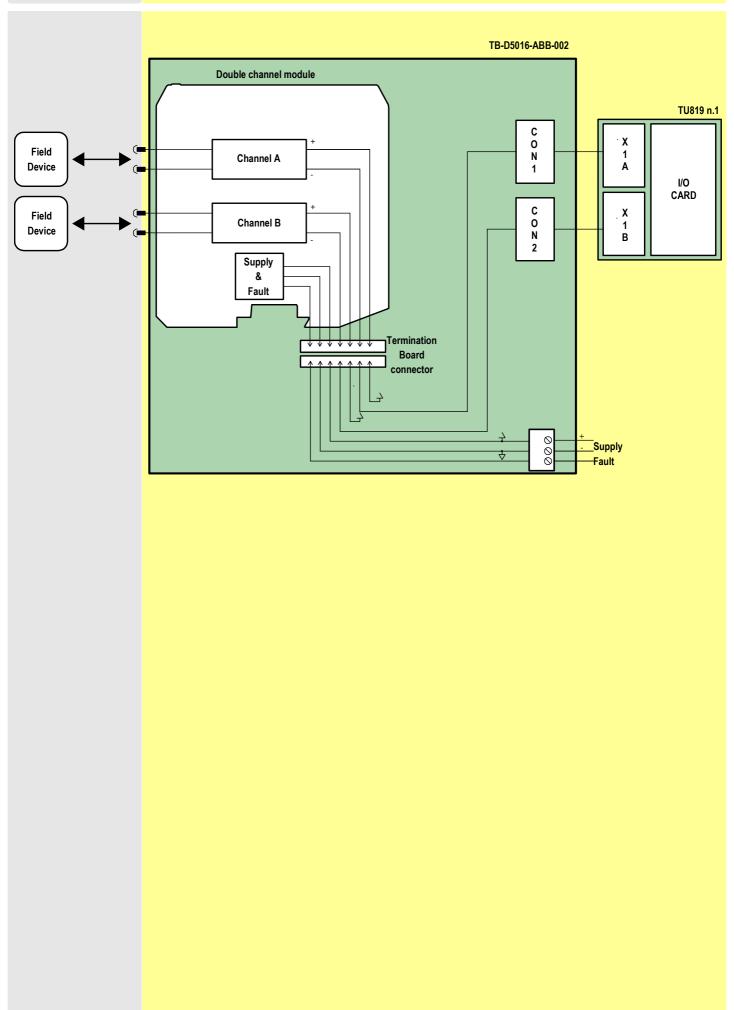

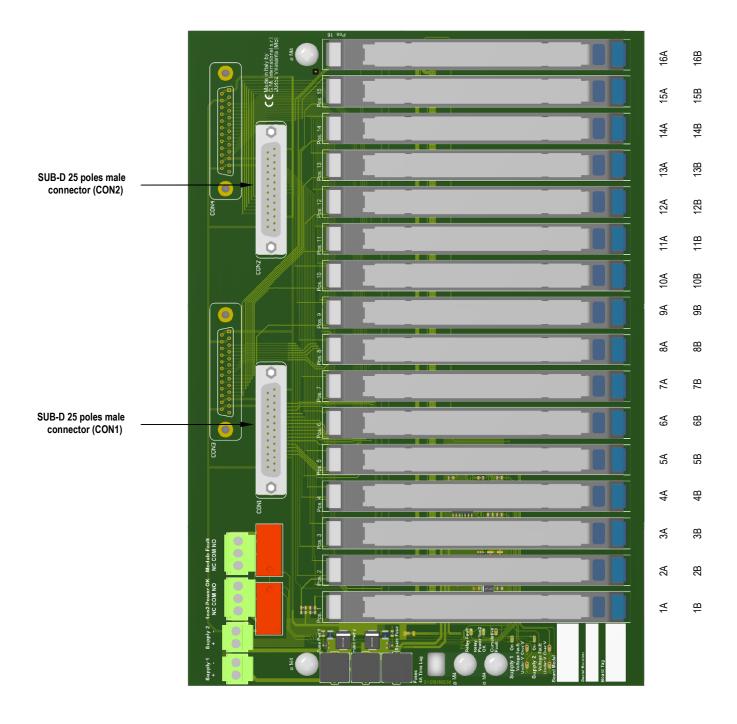

## **Connections table to Interface Cards:**


MODULE POSITION	MODULE CHANNEL NUMBER	INTERFACE CARD(S) CHANNEL NUMBER	MODULE CHANNEL POSITIVE (+) CONNECTION	MODULE CHANNEL NEGATIVE (-) CONNECTION	NOTES
4	1A	1 on TU n.1	3 (CON1)	Gnd	CON1, CON2:
1	1B	1 on TU n.2	3 (CON2)	Gnd	Pole 13 is not connected.
	2A	2 on TU n.1	16 (CON1)	Gnd	• +24 Vdc available on poles: 1, 14, 11, 24.
2	2B	2 on TU n.2	16 (CON2)	Gnd	• Ground available on poles:
2	3A	3 on TU n.1	4 (CON1)	Gnd	2, 15, 12, 25.
3	3B	3 on TU n.2	4 (CON2)	Gnd	
4	4A	4 on TU n.1	17 (CON1)	Gnd	
4	4B	4 on TU n.2	17 (CON2)	Gnd	
_	5A	5 on TU n.1	5 (CON1)	Gnd	
5	5B	5 on TU n.2	5 (CON2)	Gnd	
	6A	6 on TU n.1	18 (CON1)	Gnd	
6	6B	6 on TU n.2	18 (CON2)	Gnd	
_	7A	7 on TU n.1	6 (CON1)	Gnd	
7	7B	7 on TU n.2	6 (CON2)	Gnd	
_	8A	8 on TU n.1	19 (CON1)	Gnd	
8	8B	8 on TU n.2	19 (CON2)	Gnd	
	9A	9 on TU n.1	7 (CON1)	Gnd	
9	9B	9 on TU n.2	7 (CON2)	Gnd	
	10A	10 on TU n.1	20 (CON1)	Gnd	
10	10B	10 on TU n.2	20 (CON2)	Gnd	
	11A	11 on TU n.1	8 (CON1)	Gnd	
11	11B	11 on TU n.2	8 (CON2)	Gnd	
40	12A	12 on TU n.1	21 (CON1)	Gnd	1
12	12B	12 on TU n.2	21 (CON2)	Gnd	1
45	13A	13 on TU n.1	9 (CON1)	Gnd	1
13	13B	13 on TU n.2	9 (CON2)	Gnd	1
4.4	14A	14 on TU n.1	22 (CON1)	Gnd	1
14	14B	14 on TU n.2	22 (CON2)	Gnd	1
4-	15A	15 on TU n.1	10 (CON1)	Gnd	1
15	15B	15 on TU n.2	10 (CON2)	Gnd	1
40	16A	16 on TU n.1	23 (CON1)	Gnd	1
16	16B	16 on TU n.2	23 (CON2)	Gnd	1


## **Termination Board description:**

#### Note:

Relay contact is defined Normally Closed (NC) or Normally Open (NO) when RL1 or RL2 relays are de-energized (that is, coil status LED is turned off). Relay is de-energized in fault status.

## Power Supply redundancy:



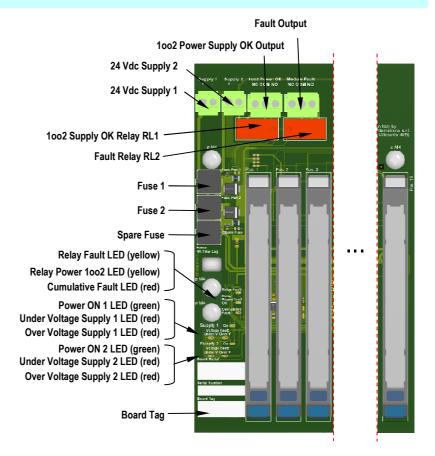

LED Signaling:

Meaning of LEDs on termination boards:


TAG	LED COLOR	MEANING
Supply 1 On	GREEN	The LED is on when the Supply 1 is present, regardless of its voltage
Supply 1 Under V	RED	The LED is on when the Supply 1 is under-voltage (<18 V)
Supply 1 Over V	RED	The LED is on when the Supply 1 is over-voltage (>30 V)
Supply 2 On	GREEN	The LED is on when the Supply 2 is present, regardless of its voltage
Supply 2 Under V	RED	The LED is on when the Supply 2 is under-voltage (<18 V)
Supply 2 Over V	RED	The LED is on when the Supply 2 is over-voltage (>30 V)
<b>Cumulative Fault</b>	RED	The LED is on when at least one module/barrier reported a fault
Relay Power 1002 OK	YELLOW	The LED is on when both supply voltages are within the regular range (>18 V and <30 V)
Relay Fault	YELLOW	The LED is on when the following two conditions hold:  1. at least one voltage supply is within the regular range (>18 V and <30 V)  2. no module/barrier fault is reported




## **Relay Activation Conditions:**

The two relays are activated according to the following rules:


TAG	ACTIVATION		
1002 Power OK (RL1)	The relay is energized when both supply voltages are within the regular range (>18 V and <30 V), i.e. when "Relay 1002 Power OK" yellow LED is on.		
Module Fault (RL2)	The relay is energized when the following two conditions hold:  1. at least one voltage supply is within the regular range (>18 V and <30 V)  2. no module/barrier fault is reported Therefore, the relay is energized when the "Fault" yellow LED is on.		

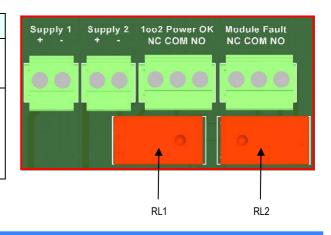


## **DIN Rail mounting overall dimensions:**

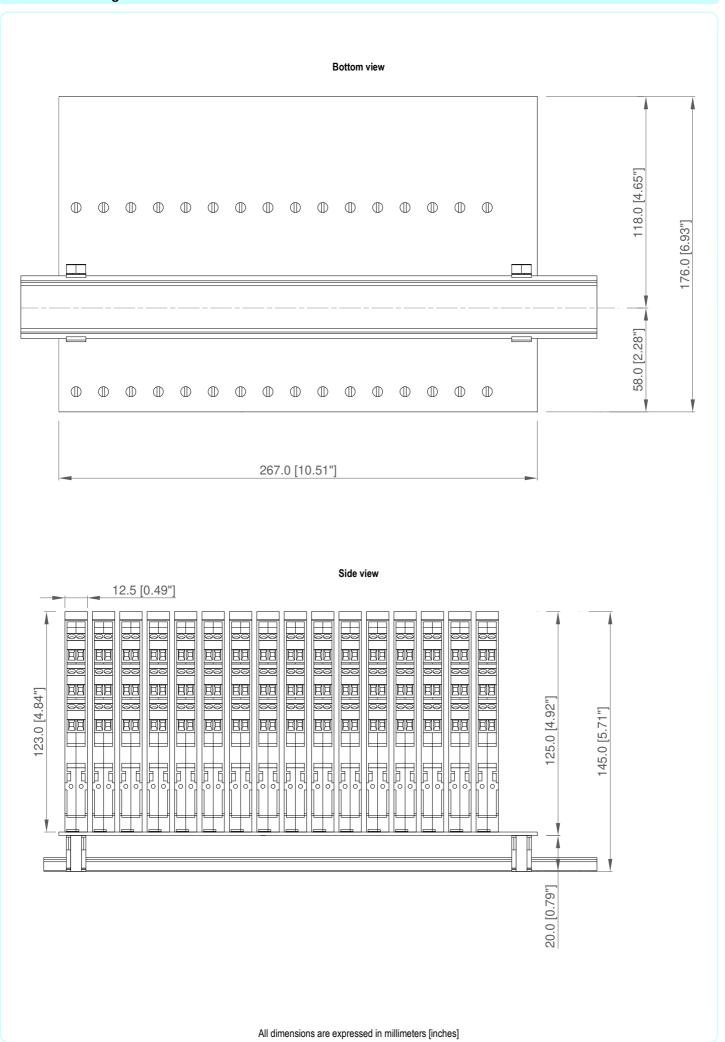


# Mounting features kit TB-OPT-001

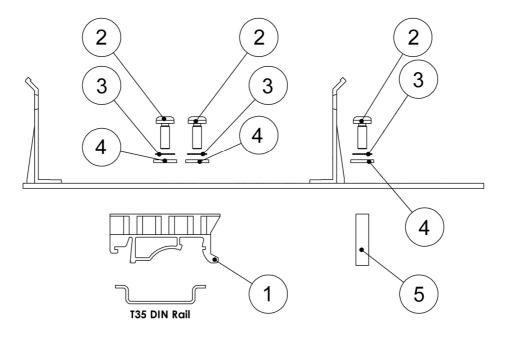


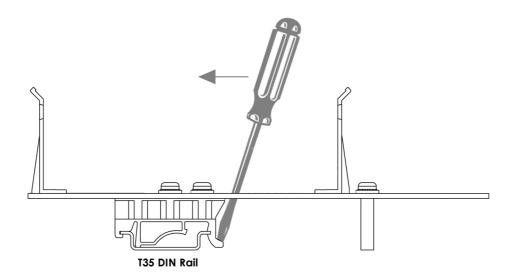

Ref. Nr	Q.ty	Description	Material
1	2	T35 Din Rail Adapter	PA
2	6	3.5 x 9.5 Self tapping screw	Stainless Steel
3	6	M3 External Tooth loch Washer	Stainless Steel
4	6	M3 Washer	Stainless Steel
5	2	6 c 20 Spacer	PA


## Wall mounting overall dimensions for M4 self tapping screw:

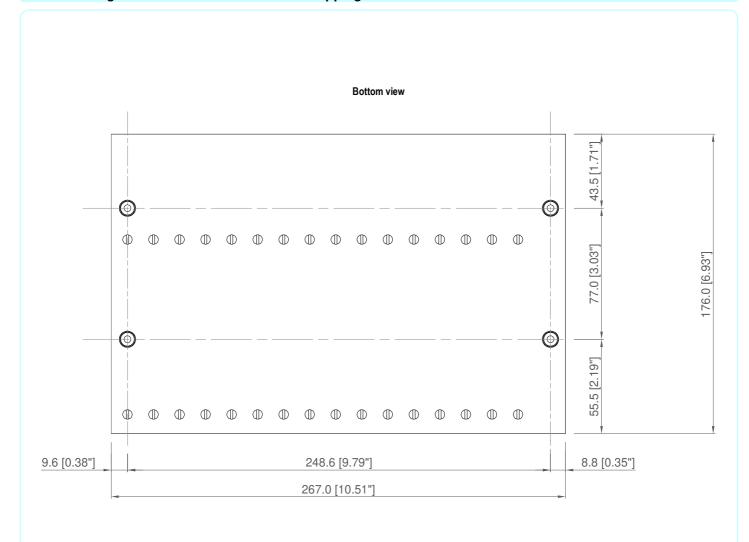

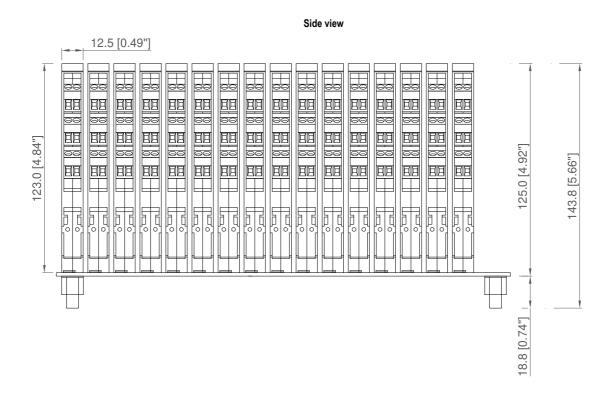


All dimensions are expressed in millimeters [inches]


## Mounting features kit TB-OPT-001

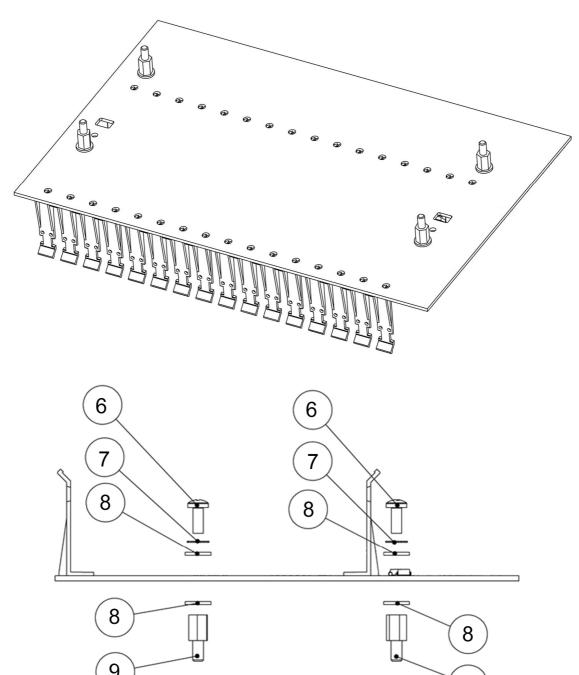

Ref. Nr	Q.ty	Description	Material
6	4	M4 x 8 Screw	Stainless Steel
7	4	M4 External Tooth lock Washer	Stainless Steel
8	8	M4 Washer	Stainless Steel
9	4	Self Tapping Spacer	NI - Plated Brass


## Wall mounting overall dimensions for M4 thread screw:

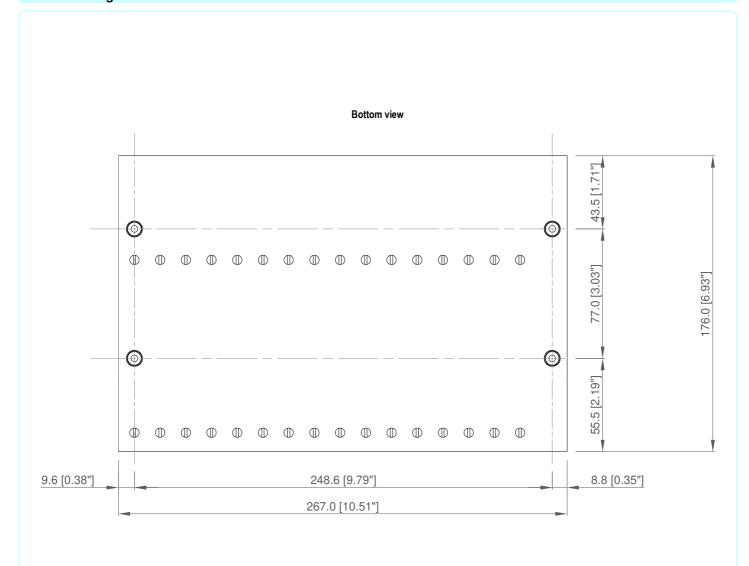

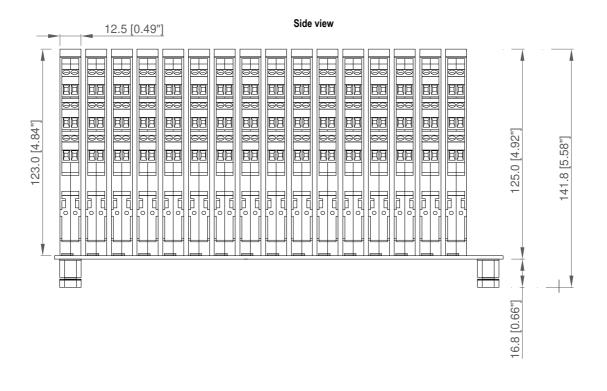

All dimensions are expressed in millimeters [inches]

# Mounting features kit TB-OPT-001

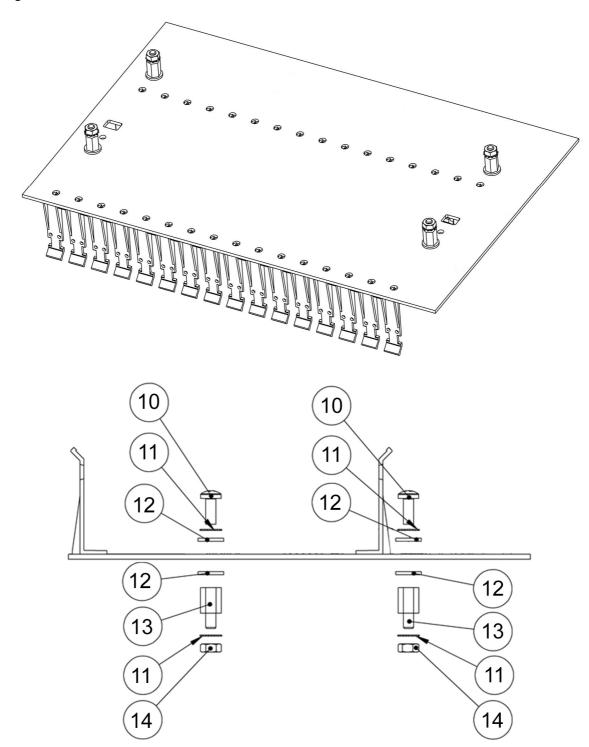

Ref. Nr	Q.ty	Description	Material
10	4	M4 x 8 Screw	Stainless Steel
11	8	M4 External Tooth lock Washer	Stainless Steel
12	8	M4 Washer	Stainless Steel
13	4	Threaded Spacer	NI - Plated Brass
14	4	M4 Nut	Stainless Steel